



California SEM M&V Guide

DRAFT VERSION 3.00, JUNE 13, 2022

PREPARED BY: SERGIO DIAS CONSULTING

*PREPARED FOR: PACIFIC GAS AND ELECTRIC, SAN DIEGO GAS AND ELECTRIC,
SOUTHERN CALIFORNIA EDISON, AND SOUTHERN CALIFORNIA GAS COMPANY*

1	INTRODUCTION.....	7
1.1	Goals and Objectives of Conducting the M&V Process	7
1.2	Terminology.....	8
1.3	Methods of Determining Energy Savings	8
1.4	Avoided Energy Consumption and Annualized Energy Savings	9
1.5	Customer Learning and Leading the M&V Process	11
1.6	Relationship to Other M&V Guides.....	12
1.7	Relationship to the NMEC Rulebook.....	12
2	SEM TIME PERIOD, TOOLS, AND REVIEWS AND REPORTS	14
2.1	SEM Time Periods	14
2.2	Tools	15
2.3	Reviews and Reports.....	17
3	CHARACTERIZING THE SITE	18
3.1	Energy Types.....	18
3.2	Energy Uses	19
3.3	Energy Meters.....	19
3.4	Energy Flows	20
3.5	Energy Map	21
3.6	Documenting M&V Boundaries.....	21
3.7	Customer Learning and Leading	21
4	RELEVANT VARIABLES	22
4.1	Identifying Potential Relevant Variables.....	22
4.2	Identifying Data Sources.....	24
4.3	Review of Relevant Variables	24
4.4	Customer Learning and Leading	25
5	PLANNING FOR ENERGY DATA COLLECTION	26

5.1	Energy Data Collection Plan	26
5.2	Energy Data and Performance Tracking Tool	28
5.3	The Opportunity Register.....	28
5.4	Customer Learning and Leading	29
6	COLLECTING DATA AND ASSESSING DATA QUALITY	31
6.1	Collecting Data	31
6.2	Reviewing for Data Outliers and Missing Data Points	31
6.3	Adjusting Data for Time-Series Offsets.....	33
6.4	Customer Learning and Leading	33
7	ENERGY CONSUMPTION ADJUSTMENT MODELING.....	35
7.1	Introduction	35
7.2	Assessing if Modeling Should be Attempted.....	35
7.3	Process.....	36
7.4	Considerations when Developing Energy Consumption Adjustment Models with Data from Multiple Meters 37	
7.5	Establishing Relationships Between Energy Consumption and Relevant Variables	37
7.6	Establishing Energy Baseline	39
7.7	Developing Energy Consumption Adjustment Models.....	40
7.8	Reviewing Competing Energy Consumption Adjustment Models.....	41
7.9	Selecting Energy Consumption Adjustment Models to Track Energy Performance and Calculate Energy Savings 43	
7.10	Ongoing Confirmation of Model Validity	43
7.11	Options when a Valid Energy Consumption Adjustment Model Cannot be Created or Models in use Fail Validity Tests.....	44
7.12	Continued Use of Energy Baselines and Energy Consumption Adjustment Model(s).....	47
7.13	Customer Learning and Leading	48
8	MONITORING ENERGY PERFORMANCE.....	49
8.1	Tracking Energy Performance with Energy Consumption Adjustment Models	49

8.2	Tracking Energy Performance with the Opportunity Register	49
8.3	Customer Learning and Leading	51
9	CALCULATING SITE-WIDE ENERGY SAVINGS WITH ENERGY CONSUMPTION ADJUSTMENT MODELS.....	52
9.1	Process	52
9.2	Confirm the Reporting Period	52
9.3	Calculating Avoided Energy Consumption Energy Savings	52
9.4	Establishing Confidence in Energy Savings	53
9.5	Calculating Incremental Energy Savings for Consecutive Reporting Periods using the Same Energy Consumption Adjustment Model.....	54
9.6	Annualization of Energy Savings.....	55
9.7	Customer Learning and Leading	56
10	PREPARING ENERGY SAVINGS FOR REGULATORY REPORTING	57
10.1	General	57
10.2	Energy Savings Terminology	58
10.3	Requirements for Claiming Savings via Top Down Method.....	59
10.4	Requirements for Claiming Energy Savings via Bottom Up Method	59
10.5	Considerations for Non-utility Energy (aka Non-IOU Fuels)	60
10.6	Negative Energy Savings	62
10.7	Customer Learning and Leading	63
11	CALCULATING DEMAND SAVINGS.....	64
11.1	Customer Learning and Leading	64
12	GREENHOUSE GAS SAVINGS.....	65
12.1	Sources of GHG Emissions.....	65
12.2	GHG Emission Scopes.....	65
12.3	Care When Selecting Methods to Determine Energy-related GHG Emissions Reductions.....	66
12.4	Methods, Guides, and Protocols Commonly used to Establish GHG Inventories and Emissions Reductions	67

12.5	SEM Program GHG Reduction Calculation Requirements	67
12.6	Customer Learning and Leading	68
13	MID-YEAR REVIEW OF THE M&V PROCESS AND RESULTS	69
13.1	General	69
13.2	Process	69
13.3	Mid-Year Review Focus Topics	69
13.4	First Time Mid-Year Review	70
13.5	Subsequent Year Mid-Year Reviews	70
13.6	Outcomes of the Mid-Year Review	71
13.7	Customer Learning and Leading	71
14	SEM REPORTING PERIOD PERFORMANCE REPORT PREPARATION CHECKLIST	72
14.1	SEM Reporting Period Performance Report Requirements	72
14.2	Customer Learning and Leading	78
	REFERENCES	79
	ACKNOWLEDGEMENTS	80
	ANNEX A - TERMINOLOGY	81
	ANNEX B – RELATIONSHIP OF 50001 READY NAVIGATOR TASKS AND M&V GUIDE SECTIONS	87
	ANNEX C - SPECIAL CASES IN ENERGY ACCOUNTING	88
	Energy Accounting of Energy Export and Energy Product	88
	On-site Extraction or Generation of Energy from Natural Resources	89
	Feedstock and Resulting Energy Types	89
	ANNEX D – BOTTOM UP EPIA CALCULATION EFFORT	91
	ANNEX E – MULTICOLLINEARITY AND AUTOCORRELATION	95
	Multicollinearity	95

Autocorrelation	95
ANNEX F – GRAPHICAL REPRESENTATION OF THE TABLE OF COMPETING MODELS.....	97
ANNEX G – FRACTIONAL SAVINGS UNCERTAINTY SCENARIOS.....	98
ANNEX H – CUMULATIVE AND INCREMENTAL SAVINGS EXAMPLE	99
Scenario 1: Backsliding reported as 0 energy savings:.....	99
Scenario 2: Backsliding claimed as negative energy savings values.	100
ANNEX I – TOTAL SYSTEM BENEFITS.....	101
ANNEX J – REVISION HISTORY.....	102

1 Introduction

Measurement and verification (M&V), in the context of the California Strategic Energy Management Program (SEM Program) is the process of:

1. Planning for the collection of data,
2. Collecting and analyzing the data collected, and
3. Measuring, verifying, and reporting energy performance or energy performance improvement for a defined boundary.

The purpose of this California SEM M&V Guide (M&V Guide) is to define a set of principles, guidelines, and requirements that establish a systematic M&V process which can be used by any stakeholder as part of participation in a publicly funded Program Administrator (PA) sponsored strategic energy management (SEM) program. The requirements of this M&V Guide shall be adhered to when a site is participating in a PA (program administrator) sponsored SEM program paid for with ratepayer funds. Outside of a PA sponsored SEM program, a site may wish to adapt this M&V Guide to suit their own energy management needs.

The site participating in the SEM program (customer), the SEM coach/implementer (implementer), and PA are the three primary stakeholders who will be engaged in conducting the M&V process.

The California Public Utilities Commission (CPUC) has specified in decision and other documentation that this M&V Guide provides the basis by which energy savings shall be determined as part of a PA sponsored industrial SEM program. The sponsoring PA will direct the customer and implementer as to when energy savings shall be reported to the CPUC for regulatory reporting. This M&V Guide should serve as the basis of the evaluation of energy savings when customers are participating in a PA sponsored SEM Program.

This M&V Guide is designed to work in coordination with the California SEM Design Guide (Design Guide) and is applicable to all customer segments (industrial, commercial, institutional, etc.). The Design Guide is framed around three, two-year SEM Program Cycles, each with its own distinct set of objectives. A common principle of the Design Guide is that over the three, two-year SEM Program Cycles the customer will first learn about and then lead aspects of a well-structured systematic energy management system (EnMS) that is based upon the ISO 50001:2018 standard.

The main text of this M&V Guide contains the requirements that shall be followed when a customer is participating in a PA sponsored SEM program. If exceptions to this M&V Guide are sought, or clarification is needed, the PA shall be contacted. The annexes of this M&V Guide contain additional guidance.

1.1 Goals and Objectives of Conducting the M&V Process

The goals of conducting the M&V process are to:

1. Develop a deeper customer understanding of the relationship between energy uses, operations, and energy consumption.
2. Determine energy and demand savings as information for customer and regulatory reporting purposes.
3. Enable the customer to lead all or a majority of the M&V process.

The objectives of conducting the M&V process are to:

1. Characterize the energy consumption, energy uses, and relevant variables of the site.
2. Develop a plan to collect energy data.
3. If possible, develop and use energy consumption models for each type of energy consumed within the M&V boundaries.

4. Quantify energy savings for implemented energy performance improvement actions (EPIA) listed on the Opportunity Register.
5. Calculate energy savings realized during a defined Reporting Period.
6. Prepare documentation for reporting to the sponsoring PA and CPUC.
7. Teach the M&V process to the customer as part of their EnMS development.

1.2 Terminology

The terminology used in this M&V Guide is consistent with the international standard ISO 50001:2018. In some cases, the terminology listed in Annex A - Terminology, of this M&V Guide provides commonly understood terms along with ISO 50001 references.

The concepts of energy performance and energy performance improvement are critical to the M&V process:

- Energy performance can be thought of as a snap shot in time of how much energy is being consumed or efficient the use of energy is.
- Energy performance improvement is related to a quantifiable change in the amount of energy consumed between two time periods during which EPIAs may be implemented.

An indefinite number of methods can be used to determine and report energy performance improvement. This M&V Guide uses estimated energy savings as an indicator of energy performance improvement. Customers may use the M&V process to develop other energy performance improvement indicators such as changes in energy intensity and energy efficiency in addition to estimations of energy savings.

1.3 Methods of Determining Energy Savings

This M&V Guide details two methods to determine energy savings. The methods are based upon:

1. One or more energy consumption adjustment models developed for each type of energy consumed within the M&V boundaries (commonly referred to as a top-down approach).
2. The aggregation of energy savings calculated for individual EPIAs implemented during the Reporting Period (commonly referred to as a bottom-up approach).

Both methods of determining energy savings are detailed in this M&V Guide.

Both methods provide value to the customer but the meaning and context of resulting energy savings values will differ and needs to be contextualized appropriately. The two methods are foundationally different and reconciliation of energy savings values calculated from use of the two different methods will result in misleading conclusions and should not be conducted as part of a PA sponsored SEM program.

1.3.1 Energy Consumption Adjustment Models

The preferred method to calculate energy savings and track energy performance over time is to develop one or more energy consumption adjustment models for each type of energy consumed within the M&V boundaries. The development and use of energy consumption adjustment models serves two primary purposes:

- **Informative tool for customers to take action with.** Energy consumption adjustment models developed to normalize energy consumption for relevant variables are tools that provide customers with information about the relationship of energy consumption, energy use, and operations. It is important that the customer work closely with the implementer to understand how energy consumption adjustment models are developed, can be used to track energy performance, and are used by the program to calculate energy savings.

- ***Making energy savings values meaningful.*** Energy savings are calculated by comparing the energy consumption of one time period to the energy consumption of another. Because variables that affect energy consumption are ever changing, the operational and external conditions of these time periods do not inherently reflect one another. By adjusting, via a regression model, the energy consumption of one of the two time periods such that the operational and external conditions are comparable, calculated energy savings values depict an accurate representation of the affect implemented EPIA and other actions have on energy consumption.

Both purposes for developing energy consumption adjustment models need to be equally considered throughout the M&V process.

In some instances, energy consumption adjustment models for each type of energy cannot be created based upon the full M&V boundary (typically the site boundary). In these cases, multiple energy consumption adjustment models may be made so long as the boundaries of each model do not overlap with one another and fit within the larger M&V boundary. When multiple energy consumption adjustment models are developed they typically focus on key processes, systems, and/or equipment. The creation of multiple models is not a requirement of this M&V Guide but is an option. The development of multiple models incurs additional effort and cost, though the customer may find greater value in using multiple models which, individually, more meaningfully relate to site operations than one overall site-wide model might.

Ideally site-wide energy savings will be determined with one or more energy consumption adjustment models, though an M&V boundary smaller than the site boundary may be used. The determination of energy savings with an energy consumption adjustment model does not rely on the calculation of energy savings of individual EPIAs, the energy savings of individual energy efficiency projects may be used in a limited capacity to provide confidence in top down based Site-wide Projected Energy Savings but is not a requirement of this M&V Guide.

1.3.2 Aggregation of Energy Savings from Individual EPIA

Regardless of whether or not energy consumption adjustment models are developed, energy savings values shall be calculated for select implemented EPIA as required by this M&V Guide. If, for a given energy type, energy consumption adjustment models are not created or used to calculate energy savings, a bottom-up approach of determining energy savings by aggregating energy savings from select individual EPIAs may be conducted. Use of aggregated energy savings from individual implemented EPIAs will most likely not capture the total energy savings resulting from behavioral, retro-commissioning, and operations (BRO) activities and other EPIAs with smaller energy savings potential.

1.4 Avoided Energy Consumption and Annualized Energy Savings

Site-wide Energy Savings can be calculated from either energy consumption adjustment models (top-down approach) or aggregation of energy savings from individual EPIAs (bottom-up approach) on an Avoided Energy Consumption or annualized basis.

The CPUC developed NMEC Rulebook defines Avoided Energy Use (in this M&V Guide referred to as Avoided Energy Consumption) as:

“...the amount of energy (or peak demand) that was not consumed or realized as a result of the energy efficiency project or program intervention. Avoided energy use is the difference between actual energy consumption in the “reporting period” and the consumption that is forecast for the same period using the “baseline energy consumption model,” and where the baseline energy consumption model use is adjusted to reflect reporting period conditions. The Avoided Energy Use approach is used as the basis of customer incentive calculations and embedded M&V reporting of savings.”

Energy savings represented as Avoided Energy Consumption represent the amount of energy savings realized during the Reporting Period. EPIAs and other energy saving actions may be implemented at any time during the Reporting Period. This means that energy savings activities implemented towards the end of the Reporting Period will not have a full 12 months of energy savings reflected in the reported Avoided Energy Consumption value. Many SEM programs report Avoided Energy Consumption energy savings.

Annualized energy savings are calculated to reflect a full 12 months of energy savings that will be realized after implementation of one or more EPIAs. Many custom capital and deemed energy efficiency programs report annualized energy savings.

Version 1.0 of this M&V Guide did not specify if energy savings should be reported on an Avoided Energy Consumption or annualized basis. In many cases top-down based energy savings were being reported on an Avoided Energy Consumption basis while bottom-up energy savings were being reported on an annualized basis.

In an effort to report SEM energy savings consistently within and between PA territories, with other PA energy efficiency programs, and at the request of the CPUC evaluator, version 2.0 of this M&V Guide included a process for annualizing top-down based energy savings and required reporting all energy savings on an annualized basis. The annualized process was adapted from one implemented by the Energy Trust of Oregon Industrial SEM program. Feedback after two years of use of this annualization process indicated the process of annualizing energy savings could be introducing unintended complications into reported values and was causing confusion when discussed with customers.

Based upon feedback from multiple stakeholders including PA staff, PA contracted implementers, CPUC staff, and CPUC contracted evaluators and considering the recommendations made in the CPUC SEM evaluation report¹ and by a PA led M&V working group, this M&V Guide has been updated to no longer require annualization of top-down based energy savings. Annualization of top-down based energy savings may be performed with PA authorization only in the case when an energy consumption adjustment model is being retired or a customer will not be participating in the SEM program after the current Reporting Period.

The CPUC SEM evaluation report recommended that consistency in reporting energy savings be prioritized regardless of the method of determining energy savings. To ensure consistency in reporting energy savings all SEM energy savings shall by default be reported on an Avoided Energy Consumption basis regardless of being determined on a top-down and bottom-up basis.

For bottom-up energy savings this means that the annualized energy savings value for individual EPIAs shall be pro-rated for the Reporting Period based upon EPIA implementation date. To ensure a full annualization of EPIA energy savings is reported, the balance of the annualized energy savings for each EPIA shall be reported in the next Reporting Period regardless of whether a top-down or bottom-up approach is used for that type of energy in the next Reporting Period. If the customer does not end up participating in the SEM program in the subsequent year the balance of the annualized energy savings for the EPIA may still be claimed in the subsequent year with no associated cost of program implementation.

The only times at which energy savings for a given type of energy are allowed to be annualized shall be when an energy consumption adjustment model will be retired or if the customer is not intending to participate in the SEM program after the current Reporting Period. If either of these conditions is met and the PA agrees, then energy savings for that type of energy for that customer shall be reported on an annualized basis. If an energy consumption adjustment model

¹ SBW Consulting Inc., Group D – D11.03 2018-19 Industrial Strategic Energy Management (SEM) Impact Evaluation, January 2022

is retired during the current Reporting Period and was used to claim Avoided Energy Consumption based energy savings in the prior Reporting Period, the unrealized energy savings between the claimed Avoided Energy Consumption energy savings of the previous Reporting Period and what would have been claimed in the previous Reporting period if Annualized Energy Savings were claimed may be claimed in the current reporting period in addition to new savings from a bottom-up approach if one is being used in the current Reporting Period.

See Section 9 for more information on calculating Avoided Energy Consumption and annualized energy savings with energy consumption adjustment models.

See Sections 8.2 for more information on calculating Avoided Energy Consumption and annualized energy savings for EPIAs.

See Section 10 for more information on reporting energy savings to the CPUC.

1.5 Customer Learning and Leading the M&V Process

The ability of the customer to conduct the process of M&V independently after completing the PA sponsored SEM program is important to the viability of the customer's energy management system and fits the trainings required by the Design Guide. Over the span of the three, two-year SEM Program Cycles, as defined by the Design Guide, it is expected, but not required, that the customer first learn from the implementer, then begin, and finally be able to independently lead the M&V processes outlined in this M&V Guide with limited assistance.

A distinction between the customer understanding and being able to ultimately lead the M&V process in general and being able to conduct activities to meet specific requirements of this M&V Guide should be made. Outside of a PA sponsored SEM program the requirements of this M&V Guide become suggestions and the customer may deviate from them as desired. As an example, the benefits of developing and using energy consumption adjustment models may not outweigh the complexity and effort needed to establish energy performance improvement in this way. The customer may rather opt to use alternative energy performance indicators.

The process of M&V documented in this M&V Guide will assist the customer beyond PA sponsored SEM program participation and customer should focus on learning to lead the M&V process activities that would be of value to them beyond the conclusion of the SEM Program Cycle. The portions of the M&V Guide that pertain to regulatory reporting and other PA and CPUC policies and requirements have limited value to the customer beyond the SEM Program Cycle.

This M&V Guide includes suggestions, rather than requirements, as to what parts of the M&V process the customer may begin leading during the three different SEM Program Cycles. These suggestions are made based upon the relationship of 50001 Ready Navigator tasks which are introduced by the Design Guide and sections of this M&V Guide. The timing of Navigator task introduction by the Design Guide is considered. A table highlighting the relationship of 50001 Ready Navigator tasks to sections of this M&V Guide is found in Annex B – Relationship of 50001 Ready Navigator Tasks and M&V Guide Sections.

In order to lead the M&V process, the customer will need to understand the activities and expected outcomes. Leading the M&V process could be accomplished by the customer themselves conducting the activities described or by the customer specifying and directing others to complete the activities then checking to ensure outcomes meet expectations.

The timing and structure to transition the leadership of the M&V process is not fixed or assumed to be the same for each customer and implementer. In general, it is suggested that:

- In SEM Program Cycle 1: The implementer leads the M&V process while the customer supports and begins to learn.

- In SEM Program Cycle 2: The customer learns to lead with significant implementer support. By the end of the SEM Program Cycle the customer is ready to lead parts of the M&V process with limited support. This does not mean the customer is able to conduct some of the more complicated parts of the M&V process, such as developing energy consumption adjustment models, but understands and can lead the overall process even if these activities are outsourced to the implementer.
- In SEM Program Cycle 3: The customer eventually leads the M&V process with limited implementer support. The implementer would still be responsible for details related to regulatory reporting.

Beyond participation in a PA sponsored SEM program, the customer should review which requirements of this M&V Guide should be altered to best fit their own needs as part of their EnMS.

1.6 Relationship to Other M&V Guides

This version 3.0 of the M&V Guide is an update to version 2.02 published September 28, 2020. This revision incorporates feedback from PA staff, contracted SEM implementers, CPUC staff, and CPUC contracted evaluators who were engaged in the first offerings and evaluation of the California SEM program. Recommendations from the first ever CPUC evaluation report of the California SEM programs, 2018-19 Industrial Strategic Energy Management (SEM) Impact Evaluation, published January 31, 2022, and PA sponsored M&V working groups have been considered and appropriately incorporated into this version of the M&V Guide.

Similar to version 1.0 of this M&V Guide, published February 8, 2017, the key principles and specifications in this version are based upon well-established SEM M&V practices and documents. Much of the technical content in this guide has been adapted from three SEM M&V documents:

- Energy Trust of Oregon Energy Production Efficiency, Energy Intensity Modeling Guideline, Version 2.2, January, 2019.
- Bonneville Power Administration, Commercial & Industrial Strategic Energy Management Measurement & Verification Reference Guide, Revision 1.0, March 31, 2022.
- U.S. Department of Energy Superior Energy Performance 50001, SEP 50001, Measurement & Verification Protocol: 2019, October 29, 2019.

This M&V Guide is consistent with the principles and compatible with:

- ISO 50015:2014 – Measurement and verification of energy performance of organizations – General principles and guidance.
- ISO 50047:2016 – Determination of energy savings in organizations.

In addition, efforts were taken to ensure consistency in technical direction with:

- ASHRAE Guideline 14:2014 – Measurement of Energy, Demand and Water Savings.
- International Performance Measurement and Verification Protocol – Option C, January 2012.

1.7 Relationship to the NMEC Rulebook

The CPUC developed Rulebook for Programs and Projects Based on Normalized Meter Energy Consumption (NMEC Rulebook) summarizes requirements for NMEC programs where energy savings are based on normalized metered energy consumption (NMEC). The purpose of the NMEC Rulebook is to provide a list of the directives and policies that have been established by the CPUC for the administration and implementation of such programs.

276 This M&V Guide and the NMEC Rulebook are based upon the common concept of determining
277 energy savings on a site-wide, existing baseline, utility meter-based approach. While the
278 concept is common, the CPUC has stated that the NMEC Rulebook and this M&V Guide are
279 separate and not interchangeable. As stated in the January 7, 2020 version 2.0 of the NMEC
280 Rulebook, "NMEC is not permissible for industrial operations and maintenance (O&M) or
281 behavior, retro commissioning, and operations (BROs)-type projects except as a component of
282 Commission defined Strategic Energy Management Programs." The NMEC Rulebook continues
283 that in Decision 18-01-004, "We clarify that this SEM program is the only program in which
284 NMEC currently may be used to assess savings in industrial sites from operations and
285 maintenance (O&M) or behavior, retro commissioning, and operations (BROs)-type activities."

286 The separation of the NMEC Rulebook and this M&V Guide reflects the CPUC understanding
287 that while the meter-based approach of the two documents contains many similarities, the
288 NMEC Rulebook is oriented towards the programs shorter in duration than the six year-long
289 SEM program.

290 When reasonable, consistency between the NMEC Rulebook and this M&V Guide has been
291 considered.

2 SEM Time Period, Tools, and Reviews and Reports

2.1 SEM Time Periods

The M&V process described in this document is assumed to be conducted on an annual basis. Specific time periods listed below are established within and outside of the annual process. Use of these time periods helps define how energy performance is monitored and energy performance improvement is determined. These time periods may be changed as the M&V process is conducted.

The time periods are defined terms (see Annex A - Terminology). Requirements for use are provided here:

2.1.1 SEM Program Cycle

A consecutive 24-month time period during which the customer engages in the SEM program. As part of a well-established energy management system, energy consumption data and relevant variable data shall be collected continuously during the SEM Program Cycle regardless of energy savings determination approach that will be used.

2.1.2 Reporting Period

Time period for which energy saving are calculated. All portions of the SEM Program Cycle shall be encompassed by one or more Reporting Periods.

The PA sponsoring the SEM program shall be responsible for establishing the duration of the Reporting Period.

As part of a PA sponsored SEM Program Cycle, the default Reporting Period is one year starting at the beginning of the SEM Program Cycle. This assumption would allow for two consecutive Reporting Periods in each SEM Program Cycle. The PA sponsoring the SEM program may prescribe different Reporting Periods.

The first Reporting Period of a SEM Program Cycle is labeled as Reporting Period 1 whether or not energy consumption adjustment models are used across multiple SEM Program Cycles.

2.1.3 Baseline Period

A consecutive 12 or 24-month period that preceeds the SEM Program Cycle and consists of a time period that is representative of normal operations within the site. During the Baseline Period energy consumption and relevant variable data are collected to create forecast energy consumption adjustment models and serves as the comparative basis by which improvements in energy performance are calculated against.

The Baseline Period shall be 12 or 24 consecutive months with the following considerations:

- 12 months: Generally appropriate for sties with weather-dependent and seasonal operations. The 12 month period could be a calendar year, fiscal year, or other designated 12 consecutive months.
- 24 months: Generally appropriate for highly seasonal models or models with monthly intervals, a 24 month Baseline Period may be optimal.

When choosing a Baseline Period length consider the reasonable ability to identify the implementation date and energy savings of EPIA implemented or non-routine events that may have occurred during the Baseline Period.

Ideally, the Baseline Period will end immediately prior to the start of the SEM Program Cycle. However, the Baseline Period shall not end more than three months prior to or after the beginning of the Reporting Period for which an energy consumption adjustment model is being developed. The three-month allowance provides for adjustments to the Baseline Period to account for abnormal operations, implementation of EPIAs, and non-routine events not

expected to be observed again. The Baseline Period shall be updated as needed based upon the requirements of this M&V Guide.

2.1.4 Annualization Period

If energy savings are being determined with the use of energy consumption adjustment models and annualization of energy savings is approved by the PA, an Annualization Period shall be established for which the annualization of energy savings can be calculated following the requirements of this M&V Guide.

2.1.5 Reporting the Current SEM Program Cycle

In any report or review, when referring to the current SEM Program Cycle on reports or as part of reviews the following full statement designed to document the customer's current and past SEM program participation shall be used: SEM Program Cycle [#] Reporting Period [#], SEM program participation year [#].

Assuming one year-long Reporting Periods the full listing of potential statements designating the current SEM Program Cycles are:

- SEM Program Cycle 1, Reporting Period 1, SEM Program Year 1.
- SEM Program Cycle 1, Reporting Period 2, SEM Program Year 2.
- SEM Program Cycle 2, Reporting Period 1, SEM Program Year 3.
- SEM Program Cycle 2, Reporting Period 2, SEM Program Year 4.
- SEM Program Cycle 3, Reporting Period 1, SEM Program Year 5.
- SEM Program Cycle 3, Reporting Period 2, SEM Program Year 6.

Use of an abbreviated version of the full listing of potential statements designating the current SEM Program Cycles can be used with the format: "SEM Program Year X" where X is the current program year.

2.2 Tools

2.2.1 Energy Map

Defined by the Consortium for Energy Efficiency, an Energy Map is, "a breakdown or map of energy end uses and costs across the company. This should include all significant end use systems, as well as other relevant variables of energy consumption such as production, weather, and product mix."²

The Energy Map is intended to identify and show where and how much energy is used within a site, create awareness of site-wide energy use, and help prioritize the identification of energy-saving opportunities based on areas of high energy use in a site.

An Energy Map Tool, likely Excel-based, that helps the customer build a basic Energy Map, and optionally a detailed Energy Map, shall be provided to customers to help them organize and understand energy use at their site by area or system.

2.2.2 Energy Data Collection Plan

The Energy Data Collection Plan includes information describing when and how data should be collected from identified data sources. The Energy Data Collection Plan shall address the collection of energy consumption and relevant variable data.

2.2.3 Energy Data and Performance Tracking Tool

The Energy Data and Performance Tracking Tool shall be designed and used to capture energy consumption and relevant variable data. Data captured by The Energy Data and Performance

² Consortium for Energy Efficiency (CEE), CEE Strategic Energy Management Minimum Elements, February 2014

Tracking Tool shall also be used to track energy performance as determined by energy consumption adjustment models over time.

To ensure the customer can access their own data and continue to record and track data after an SEM Program Cycle, the implementer shall provide and ensure the customer can record and track data in a no-cost Energy Data and Performance Tracking Tool. An Excel based tool is likely to be provided as the underlying software is typically available to the customer. Other no-cost tools are acceptable so long as the customer can maintain access to the tools at no-cost beyond the SEM Program Cycle.

If the customer would rather use their own data collection tool, the implementer shall ensure it is configured to track all data identified in the Energy Data Collection Plan and data will be exportable to provide to the sponsoring PA if needed.

In addition to the no cost tool, and with approval from the sponsoring PA, implementers are permitted to make available to customers proprietary/for fee software tools to serve as the Energy Data and Performance Tracking Tool so long as data contained with these tools can be extracted and used to populate the no-cost Energy Data and Performance Tracking Tool at the conclusion of the SEM Program Cycle.

2.2.4 Energy Consumption Adjustment Model Development Tool

The implementer shall provide and show the customer a no-cost Energy Consumption Adjustment Model Development Tool. As part of a PA sponsored SEM program there are no specific software requirements for building energy consumption adjustment models so long as the resulting model meets all validity requirements of this M&V Guide. Consider the software's flexibility and its ability to iterate quickly on relevant variable combinations. The customer does not have to be able to demonstrate an ability to use the tool but shall be shown the tool and its use described such that if the customer desires to use the no-cost beyond the PA sponsored SEM program they can do so.

In addition to the no-cost tool, and with approval from the sponsoring PA, implementers are permitted to make available to customers proprietary/for fee software tools to serve as the Energy Consumption Adjustment Model Development Tool so long as data contained with these tools can be extracted and used to populate the no-cost Energy Consumption Adjustment Model Development Tool at the conclusion of the SEM Program Cycle.

2.2.5 Opportunity Register

The Opportunity Register helps the customer prioritize and track opportunities to improve energy performance and their EnMS. The Opportunity Register is also an important piece of evidence of program influence as part of the CPUC's evaluation of the SEM program. The Opportunity Register is required to include data that will directly aid the customer as well as the CPUC evaluator.

The implementer shall provide and ensure the customer can record and track data in a no-cost Opportunity Register. An Excel based tool is likely to be provided as the underlying software is typically available to customers. Other no-cost tools are acceptable so long as the customer can maintain access to the tools at no-cost beyond the PA sponsored SEM Program Cycle.

In addition to the no-cost tool, and with approval from the sponsoring PA, implementers are permitted to make available to customers proprietary/for fee software tools to serve as the Opportunity Register so long as data contained with these tools can be extracted and used to populate the no-cost Opportunity Register at the conclusion of the SEM Program Cycle or at the request of the PA or customer.

2.2.6 Energy Management Assessment

The Energy Management Assessment (EMA) process described in the Design Guide will result in a quantitative output metric of EnMS development. This metric will be reported as part of the Mid-Year Review and SEM Reporting Period Performance Report. The requirements pertaining to the specific EMA and reporting of results detailed in the Design Guide shall be followed.

If the EMA question set required for use by the Design Guide is put into a proprietary/for fee tool, the underlaying question/statement set shall be made available to the customer at no cost and in a format of the customer's choosing.

2.3 Reviews and Reports

2.3.1 Mid-Year Review

The Mid-Year Review is an annual review of the M&V process conducted between the implementer and PA sponsoring the SEM program. The SEM program is a long duration engagement with integrated business practice development, EPIA implementation, and M&V activities, the PA has interest in ensuring the program is "on track" prior to annual submission of energy savings and future CPUC evaluation. An annual Mid-Year Review of the M&V process and key SEM program design components shall be conducted between the implementer and PA sponsoring the SEM program to ensure the program deliverables, including M&V deliverables, are being met prior to year-end reporting. The Mid-Year Review is not designed to be part of the CPUC evaluation process.

2.3.2 SEM Reporting Period Performance Report

The SEM Reporting Period Performance Report is a living documentation of the activities and outputs of the M&V process. The SEM Reporting Period Performance Report is intended to be for the PA sponsoring the SEM program but may be of use to the customer as a record of the M&V process that can be used in subsequent years.

3 Characterizing the Site

M&V is conducted for a defined set of boundaries. The process of establishing M&V boundaries is based upon developing an understanding of the:

- Types of energy consumed,
- Energy uses,
- Energy meters, and
- Energy flows at the site

In many cases, establishing M&V boundaries may be relatively straightforward depending on the nature of the site and what information is already available. If the M&V process is being conducted as part of a PA sponsored SEM program, the M&V boundaries most likely will be the same as those used to define the site as part of the SEM program. M&V boundaries should align with the location of energy meters and energy uses such as production lines, process systems, buildings, and other equipment.

Depending on the site complexity, interest of the customer, and challenges creating energy consumption adjustment models for a site-wide M&V boundary, smaller M&V boundaries may be needed or more useful in understanding energy performance improvement.

Review of the M&V boundaries should be conducted regularly. The process of updating M&V boundaries is based upon detailed knowledge of energy consumption, energy use, and general operations within the site. This is information the customer should have intimate knowledge of.

This review could be a simple review to confirm what, if any, changes to the types of energy consumed, energy uses, energy meters, operations, and potentially relevant variables have occurred at the site and need to be reflected. If changes to the site, including the addition or removal of on-site generation and site expansions, have occurred an assessment should be made to understand how they may affect the M&V boundaries and other parts of the M&V process.

Subsequent parts of the M&V process may reveal a need to revisit M&V boundaries.

The process of first establishing and then reviewing M&V boundaries shall be conducted annually.

3.1 Energy Types

The scope of the M&V process shall include all energy types, which are delivered to, consumed within, and delivered away from the M&V boundaries. The originating source (e.g., utility, on-site generation, other organization) of the energy should be noted but does not prohibit any energy types from being included in the M&V process.

In some instances, to aid energy consumption adjustment model development it may be useful to remove energy conversion equipment from the M&V boundaries such that the energy the equipment produces is accounted for rather than the energy that enters it (e.g., account for the steam produced by a boiler rather than the biogas that feeds it, account for the electricity after the inverter that is generated by an on-site PV panel). See Annex C - Special Cases in Energy Accounting for examples of how to establish the delivered energy value for various M&V boundary situations.

Based upon the working understanding of the M&V boundaries a list of all energy types that the customer has authority of and that are delivered to, consumed within, and delivered away from the boundaries shall be created.

3.1.1 Quantifying Energy Consumption

For each energy type included in the M&V process, site-wide energy consumption shall be equal to or greater than zero.

If site-wide energy consumption for a given type of energy is calculated to be a negative value, it shall be accounted for as zero. In such cases, care shall be taken to ensure energy export and energy product are correctly accounted for.

3.1.1.1 On-site Energy Generation and Conversion

M&V boundaries are considered three-dimensional, thus energy accounting shall include energy that enters the M&V boundaries from the sky (e.g., rooftop solar PV) and ground (e.g. on-site natural gas extraction) if consumed at the site in the form of an energy type for which energy savings are being determined.

The establishment of M&V boundaries shall consider on-site energy conversion equipment such as a Combined Heat and Power (CHP) system, natural gas fueled gas turbine engine, or biogas fueled boiler.

This consideration shall include analysis of how energy converted from one type to another (e.g., natural gas to steam and electricity) are ultimately consumed by energy uses within the M&V boundary and the consideration for how those energy types will be used in the future development of energy consumption adjustment models.

3.1.1.2 Types of Energy with Relatively Insignificant Consumption

A given type of energy may be omitted from the M&V process only if it accounts for 5.0% or less of the site's total prior year annual delivered energy.

In calculating the percent of total consumption represented by an omitted energy type, both the energy consumption of the omitted energy type and total site energy consumption shall be calculated on a delivered energy basis.

The determination to omit energy types shall be based on measured data or calculated analysis and documented in the SEM Reporting Period Performance Report.

EXAMPLE: A site that produces and freezes large quantities of processed foods uses propane for two forklifts. The annual energy consumption of propane is calculated to be 2.5% of site total energy consumption. As a result, propane is omitted from the M&V process.

Justification for the omission of a given type of energy shall be documented.

3.2 Energy Uses

M&V boundaries shall be defined to encompass important energy uses such as production lines, process systems, and buildings as appropriate.

Uses of energy that consume a significant quantity of energy or are important to the operations at the site shall be identified.

If as part of the EnMS, significant energy use (SEU) selection criteria was developed, this criteria shall be used to identify SEUs.

3.3 Energy Meters

Data regarding the quantity of energy delivered into or away from the M&V boundaries (delivered to the site, delivered away as energy export, delivered away as energy product, or feedstock) may be available directly from energy meters (utility or submeters) or taken from a supplier invoice. Based upon the location of energy meters the M&V boundaries may need to be adjusted.

Use of existing utility energy meters may be sufficient to quantify the delivered energy.

If utility energy meters serve buildings, equipment, processes or other energy using systems outside the M&V boundaries (nominally outside the SEM program boundaries if the customer is participating in a PA sponsored SEM program) for which energy performance and energy savings are being determined, submeters shall be used to net out the energy consumption of these energy uses.

All utility and other relevant energy meters for all types of energy delivered to or away from the M&V boundaries as well as energy submeters shall be documented.

For each energy meter, the meter serial number, utility account number, or other unique identifiers shall be documented. The meter units and metering interval shall be documented. The major processes monitored by each energy meter shall be documented.

3.4 Energy Flows

The quantity of a particular type of energy that is consumed within the M&V boundaries is defined by the net energy flow of that energy type across the M&V boundaries.

Process flow diagrams, piping and instrumentation diagrams, and value stream maps can be helpful in creating diagram(s) that show energy flows. Indicate the flow of each type of energy on this diagram. The energy flows trace the “path” energy takes from the point it is delivered to the M&V boundaries and to the energy end uses. If applicable, the energy flows will include the “path” energy may take into and out of on-site storage, delivered away from the site as an energy product or energy export.

The energy content of the energy flows that do not terminate in energy end uses within the M&V boundaries will need to be netted out to correctly establish the amount of delivered energy.

The energy flow diagram does not need to include energy units, be to scale, and is an illustrative diagram of the various energy uses and sources within the M&V boundaries.

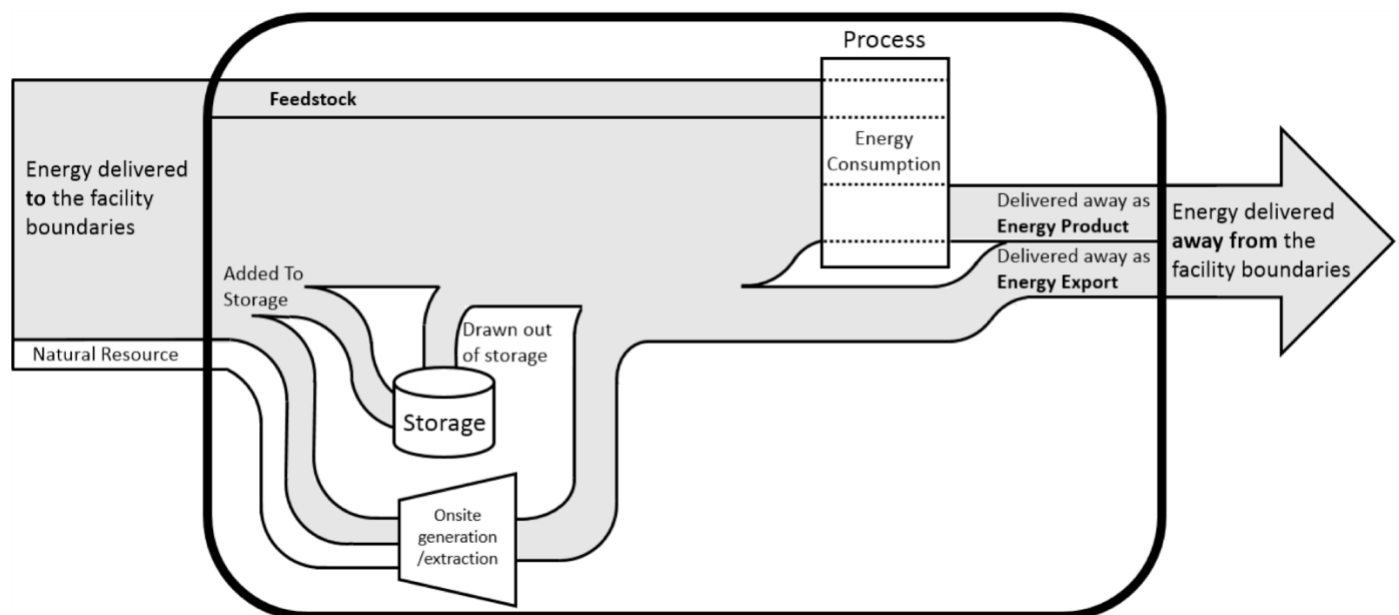


Figure 1: Generic Energy Consumption Accounting Flow Diagram.

The below equation describes how to calculate energy consumption. Figure 1 graphically illustrates this relationship.

565 Delivered Energy = energy delivered to the site + onsite generation/extraction –
566 energy delivered away as export –
567 energy delivered away as product + energy drawn out of storage –
568 energy added to storage – energy used as feedstock

569 An energy flow diagram shall be created.

570 Additionally, if energy is used as a feedstock this shall be noted as part of the energy flow.

571 **3.5 Energy Map**

572 An energy map shall be developed through the process of establishing M&V boundaries and
573 reviewed annually.

574 The Energy Map shall contain at a minimum a listing of energy uses at the site and for each
575 energy use listed associated types of energy consumed, rough estimate of energy consumed,
576 and associated relevant variables. Notation of which energy uses are selected as Significant
577 Energy Uses (SEUs) and the criteria for selecting them shall be made on the Energy Map.

578 **3.6 Documenting M&V Boundaries**

579 Documentation of M&V boundaries shall include a description and one or more clearly marked
580 line drawings or aerial images of the site.

581 The line drawing(s) or aerial image(s) shall include demarcation of buildings and major
582 equipment and processes, energy meters, and energy flows within the M&V boundaries.

583 Special note shall be made regarding the location and interrelationship of energy conversion
584 equipment (e.g., CHP, on-site generation).

585 **3.7 Customer Learning and Leading**

586 **SEM Program Cycle 1:** The implementer should lead the process of establishing M&V
587 boundaries with engaged participation from the customer. Annual review of the M&V boundaries
588 should be led by the implementer with participation from the customer. Updates to the Energy
589 Map should be led by the implementer with customer engagement.

590 **SEM Program Cycle 2:** The customer should be significantly engaged in the annual review and
591 update of M&V boundaries and Energy Map as needed. The implementer should be an equal
592 partner in this process.

593 **SEM Program Cycle 3:** The customer should lead the annual review and update of the M&V
594 boundaries and Energy Map with the implementer supporting and ensuring the requirements of
595 the M&V Guide are followed.

596

4 Relevant Variables

Relevant variables are quantifiable factors that routinely change and have a major impact on energy performance, including operational performance, and which directly affect the amount of energy consumed within the M&V boundaries. Relevant variables may or may not be in the control of the customer.

EXAMPLES: Production quantities, equivalent products, number of batches, heating degree-days, humidity, occupancy, hours worked, number of shifts, customers served, and raw material characteristics.

Relevant variables are used to normalize energy consumption as part of an adjustment model. Relevant variables can also be used with other methods of tracking energy performance and determining energy performance improvement.

It is important to select a suite of relevant variables that will fully represent the use and consumption of energy within the M&V boundaries. Equally, it is important to not collect data on variables that have no bearing on the use and consumption of energy.

Sites with complex or diverse operations, for which there may be difficulty creating a single site-wide energy consumption adjustment model for each type of energy, should consider assessing additional potentially relevant variables that may be more directly related to a discrete process, building, or other operation that could be modeled in isolation.

Regular simple reviews of relevant variables should be conducted to ensure they are still relevant to the site's energy consumption.

A full review of selected relevant variables may be needed if additional or different energy consumption adjustment models are to be created or if significant operational changes have occurred at the site.

4.1 Identifying Potential Relevant Variables

In order to develop robust and meaningful adjustment models, care shall be taken to avoid:

- Omitting relevant variables that affect energy consumption.
- Including variables that do not directly affect energy consumption.

The process of identifying relevant variables shall be conducted before attempting to develop energy consumption adjustment models.

A first step in this process is to assess where production data is available relative to energy-intensive processes. If a significant time offset exists between the energy-intensive process and the measurement point for a potential relevant variable, a note that a time-shift in interval data is needed to align the production data with energy consumption data shall be made.

Relevant variables shall be physical quantities, characteristics, or conditions. Financial metrics or metrics that include a financial component, such as product price or energy costs shall not be considered as relevant variables as they lack a physical relationship to energy consumption.

The following variables shall be considered for inclusion as relevant variables:

- Activity level (e.g., operating hours, operating mode (weekend/weekday), production level, product mix, and equivalent products, occupancy, etc.).
- Weather (e.g., heating degree-day, cooling degree-day, ambient temperature, and humidity, etc.).

Using engineering judgment, a list of potentially relevant variables that may or may not be included in the energy consumption adjustment models shall be developed.

For each potentially relevant variable included on this list, the energy type and energy use (of those identified in Section 3) that the relevant variable is suspected to affect shall be indicated.

4.1.1 Production Metrics

For industrial sites, a metric of production is often included as a relevant variable. It is important to understand how many product types are manufactured in a site and whether there is likely to be a difference in energy consumption based on operating parameters such as product type, process flow, or batch size. Site personnel who work closely with energy uses typically have insight into what variables should be considered. By thinking openly about which variables may affect energy consumption and how those variables relate to one another, the chances of developing a robust energy consumption adjustment model will be increased.

EXAMPLE: A site that produces two types of products, one of which is very energy intensive to produce and the other which is not, may consider including production levels from both products rather than an aggregated production value.

If multiple production variables are available, process flow diagrams and energy maps may be useful to identify potentially interactive effects and correlations. Using multiple measurement points in the same process line may not be necessary or beneficial. See Annex E – Multicollinearity and Autocorrelation, for more details.

Measurement Points	Pros	Cons
Raw material input	Provides a mechanism for capturing the effects of different types of raw materials.	Fails to provide a mechanism for understanding energy impact of yield/productivity improvements.
In-line metric	Allows for the selection of a production variable at energy-intensive processes, thereby minimizing a time-series shift.	Fails to provide a mechanism for incentivizing the energy impact of yield/productivity improvements downstream, from point of measurement.
End-of-line metric	Provides a mechanism for incentivizing the energy impact of yield/productivity improvements.	May induce a time-series shift for long lead-time processes.
Finished product shipped	Data can be captured via accounting systems.	May not sync with production depending on dwell time in the warehouse.

Table 1: Options for Production Relevant Variables

Raw material, in-line production, and finished product metrics each have pros and cons as relevant variables. An informed decision will take into account factors such as lead time, the desire to account for yield effects, as well as the prevalence of inventory fluctuations in-process or at the finished-product stage.

4.1.2 Weather Metric Requirements

One or more weather metrics such as outdoor air temperature, wet bulb temperature, heating degree day (HDD), cooling degree day (CDD) and rainfall will often be used in the formation of an energy consumption adjustment model.

Weather data shall be actual weather data from published government sources, such as primary National Oceanic and Atmospheric Administration (NOAA) weather stations, the National Climate Data Center (NCDC) database, or from a calibrated weather meter within close enough proximity to the site to reflect the weather conditions at the site.

If on-site weather station data is to be used it shall be calibrated per the manufacturer's specifications and confidence established that the station will be available through the SEM program cycle.

The customer must be able to access the same data during and after the SEM Program Cycle in order to be able to update the model themselves upon completion of the SEM Program Cycle.

In some cases, weather stations report in coordinated universal time (UTC) time, which means a daily average is not representative of a 12:00am-11:59pm day in local time. Proper time zone offsets shall be applied to data before averaging into a daily, weekly, or monthly interval.

If being used in the formulation of energy consumption adjustment models that will be used to report energy savings to the CPUC, HDD and CDD shall be calculated based upon at least daily data.

4.1.3 Indicator Variables and other Relevant Variables

Based on the energy map and energy uses, consider which other relevant variables may affect energy consumption such as raw material properties, operational modes (weekend/weekday) occupancy, shifts, and hours.

Indicator variables can represent tangible changes to operations, sites, and processes. Positively, the use of an indicator variable can help ensure energy consumption adjustment models are meaningfully constructed. Negatively, indicator variables can be developed semi-arbitrarily to ensure a model can be created regardless of the resulting model being meaningful. Whenever an indicator variable is used in a model, define whether it is a one-time change or a reoccurring event that will also apply in the Reporting Period.

An indicator variable could be used in conjunction with production data to create an artificial offset for regular non-production days. In this case as the indicator variables would establish a level of energy consumption for non-production days on which energy consumption would increase as production level rise.

Indicator variables may be used to represent seasonal changes, energy projects during the Baseline Period or other changes.

4.2 Identifying Data Sources

If possible, data sources for each potentially relevant variable shall be identified.

The list of potentially relevant variables shall be amended to include data sources.

For each data source, the serial number or other unique identifiers for meters that would be used to collect data shall be noted.

Data source descriptions shall be specific so that an individual familiar with the systems and operations of the site could understand where and how to collect relevant variable data.

Based upon energy consumption adjustment modeling efforts and with customer input, a list of relevant variables for which data will be collected shall be assembled.

Review of which variables are selected as relevant variables shall be conducted annually, reflecting lessons learned from the prior year and taking into account planned changes to the site.

Relevant variables shall be added and removed from the list of potential relevant variables as needed to reflect changes to energy uses and operations as well as taking into account feedback from efforts to establish energy consumption adjustment models.

Data for relevant variables shall be collected on an ongoing basis.

4.3 Review of Relevant Variables

As needed, alternative relevant variables to facilitate model development may need to be identified.

An annual review, proportional to the changes that have occurred at the site since the last review and reflecting the need to develop any new energy consumption adjustment models, shall be conducted.

4.4 Customer Learning and Leading

SEM Program Cycle 1: The process of identifying potential and selecting relevant variables to track over time should be led by the implementer. The customer should be shown how and why relevant variables were selected.

SEM Program Cycle 2: The implementer should equally work with the customer to evaluate if currently selected relevant variables are still appropriate.

SEM Program Cycle 3: The customer should lead the process of assessing if currently selected relevant variables are still appropriate. The implementer should support the customer and ensure the requirements of this M&V Guide are met.

5 Planning for Energy Data Collection

Preparing for the collection of data involves the creation and update of an Energy Data Collection Plan, Energy Data and Performance Tracking Tool, and Opportunity Register.

As part of a PA sponsored SEM program, be aware of relevant PA or CPUC policies related to data collection and the source of energy, specifically for non-utility supplied energy and if a Public Purpose Program (PPP) charge is paid by the customer.

5.1 Energy Data Collection Plan

5.1.1 Developing the Energy Data Collection Plan

The Energy Data Collection Plan shall be developed to accommodate collection of energy consumption and relevant data identified as part of the M&V process, the process by which the data will be collected, and the persons responsible for collecting the data.

The implementer shall work with the customer to develop an Energy Data Collection Plan being sure to identify who is responsible for collecting data, how often they are to collect data, and that they know how to record data in the Energy Data and Performance Tracking Tool.

The development and maintenance of the Energy Data Collection Plan shall be in part based upon information assembled when establishing M&V boundaries and selecting relevant variables. In addition to these considerations, the Energy Data Collection Plan shall include details identified in this section of the M&V Guide as well as by the PA and implementer if participating in a PA sponsored SEM program.

The Energy Data Collection Plan shall list the energy meters and relevant variables data sources for which data will be collected.

For each of these data sources the Energy Data Collection Plan shall indicate:

- How the data are to be collected.
- The frequency of data collection.
- Data storage method and location.
- The person(s) responsible for collecting and storing the data.
- The person(s) responsible for conducting quality control of the data.

A consistent and reliable process for acquiring and recording data shall be developed and recorded.

The steps (detailed appropriately to the skills, experience, and abilities of the person collecting the data) to be followed ensure timely acquisition and quality control of data shall be listed.

A complete collection process shall include:

- Data required.
- Data location.
- Method of analysis to ensure data quality.

In some sites, a data collection process may already be in place and can be utilized. If data that need to be collected are not already collected, then determine if the organization has the means to collect the data.

If not, the customer shall acquire additional metering equipment or identify different data that will fulfill the same need. The Energy Data Collection Plan shall reflect if such considerations are needed.

771 *5.1.1.1 Meter Data*

772 Energy meters (utility or submeters) may directly report energy consumption values or physical
773 properties such as pressure, temperature, mass, volumetric flow, and heating value that can be
774 used to calculate energy consumption by using equations and conversion factors

775 Equations and conversion factors used to convert meter output data to other metrics and values
776 shall be documented.

777 Quantification of energy consumption or of a relevant variable via subtraction of readings from
778 two or more calibrated meters is acceptable.

779 *5.1.1.2 Frequency of Data Collection*

780 Energy and relevant variable data shall be collected at least monthly if not more frequent (e.g.,
781 weekly, daily, and 15-minute interval).

782 In general, more frequent data collection can be beneficial in the development of robust energy
783 consumption adjustment models.

784 The frequency of data collection may take into consideration the frequency at which energy
785 consumption data and relevant variable data can be obtained and be meaningful.

786 While this M&V Guide makes this conditioned allowance for a slower collection of data, it is
787 highly encouraged that data be collected at the most frequent rate possible for possible future
788 use. More frequently collected data can be aggregated together to match the rate at which
789 relevant variable data can be collected when forming energy consumption adjustment models
790 (e.g., 15-minute interval electricity consumption data can be aggregated to a weekly basis if the
791 relevant variables associated with electricity are only available on a weekly basis).

792 *5.1.1.3 Energy Types with Multiple Sources and Meters*

793 When a particular energy type is delivered to the M&V boundary from multiple sources (e.g.,
794 utility supplied electricity and on-site generated electricity from a PV system, chilled water
795 delivered by another organization and water chilled by a chiller supplied with utility delivered
796 electricity) or from multiple meters for utility supplied energy, the quantity of energy from each
797 originating source shall be recorded separately.

798 These values may be aggregated in the formation of energy consumption adjustment models
799 but the disaggregated values shall be recorded independently for regulatory reporting purposes.

800 *5.1.1.4 Meter Calibration*

801 All data used as part of the energy accounting, including those for energy consumption and
802 relevant variables, shall be taken from measurement systems.

803 If energy consumption data are taken from a source other than the utility meter, calibration of
804 that meter shall follow the manufacturer's recommendations.

805 Calibration records and records of repairs to calibrated meters shall be maintained by the
806 customer and available for the implementer to review if requested.

807 Calibration records for utility meters are not the responsibility of the customer or implementer
808 and do not need to be maintained.

809 If non-utility meters are not calibrated following the manufacturer's recommendation or if
810 calibration records and records of repairs to calibrated meters are not available then data from
811 these meters shall not be used for determining energy savings.

812 *5.1.2 Updating the Data Collection Plan*

813 The implementer shall check in with the customer on a regular basis to ensure the Energy Data
814 Collection Plan is being updated as needed.

When major changes occur at the site the customer shall inform the implementer and together assess what changes are needed to the Energy Data Collection Plan.

The Energy Data Collection Plan shall be reviewed and updated on at least an annual basis following review of the M&V boundaries and selection of relevant variables.

The Energy Data Collection Plan may need to be additionally updated if it is found to be ineffective, identified meters are removed or added, additional relevant variables are identified, or other extenuating circumstances arise.

Changes to the Energy Data Collection Plan shall be documented.

The updated Energy Data Collection Plan shall be put into place and used to retroactively collect data for the SEM Program Cycle and any time prior as needed.

5.2 Energy Data and Performance Tracking Tool

An Energy Data and Performance Tracking Tool shall be developed based upon the Energy Data Collection Plan. The Energy Data and Performance Tracking Tool shall be reviewed annually.

5.3 The Opportunity Register

The Opportunity Register is a living document and shall be inclusive of energy performance and EnMS improvement opportunities identified and completed outside of and during the multiple year PA sponsored SEM program (i.e. the Opportunity Register should include identified and completed opportunities from prior year engagements in the PA sponsored SEM program). The implementer shall work with the PA and customer to identify opportunities that have been identified, planned, and implemented at least two years prior to the start of the first SEM Program Cycle the customer participated in.

The Opportunity Register is used by the CPUC to determine influence of PA sponsored SEM programs. As such, some required components of the Opportunity Register may provide less value to the customer than others. Outside of a PA sponsored SEM program the customer can alter the Opportunity Register to meet their own needs.

5.3.1 Establishing the Opportunity Register

An Opportunity Register shall be created to accommodate data related to Energy Performance Improvement Actions (EPIAs) and EnMS improvement opportunities.

The Opportunity Register shall include the following sections and fields for entry:

- A description section:
 - ID number,
 - Name,
 - Description (e.g. Replace outside air damper actuators in all AHUs, place employee energy savings opportunity box in break room),
 - Process/system category (e.g. HVAC, lighting, compressed air, pumping, opportunity identification),
 - Process/system description (e.g. equipment type, size, capacity, load, operating conditions),
 - Location (e.g. Building 7, process line 3),
 - Opportunity type (e.g. capital, process, maintenance, operational, behavioral, EnMS)
- An identification section:
 - Identified by (e.g. SEM treasure hunt, IOU assessment, employee suggestion, internal audit, management review)
 - Identification date

- SEM influence (binary entry: “yes” or “no,” depending if measure was identified or planned as part of a PA sponsored SEM program or not, see Section 8.2.2)
- A prioritize section:
 - Qualitative (e.g. low, medium, or high) or quantitative indicator of estimated energy saving for energy types primary affected
 - Qualitative (e.g. low, medium, or high) or quantitative indicator of cost/effort required,
- A planning section:
 - Next steps (or the required actions to complete),
 - Owner (i.e. who is responsible to moving the opportunity forward as appropriate)
 - Target implementation date
- An ensure persistence section:
 - Backsliding risk (i.e. how likely it is that the energy savings from this project will decline without regular attention paid by key personnel),
 - Persistence strategy (brief description, this should likely be documented more fully elsewhere),
 - Persistence review date.
- An implementation section:
 - Implementation status (e.g. implemented, implementing now, implement later, not to be implemented, not implement)
 - Implementation status date (i.e. the date the implementation status was updated)
 - Implementation date,
- A results section:
 - Annualized energy savings for each type of energy affected,
 - Reporting Period pro-rated energy savings for each type of energy affected,
 - Annualized demand savings for each type of energy affected,
 - Reporting Period pro-rated demand savings for each type of energy affected,
 - Notes where documentation for data, calculations, and other details can be found

The results section shall be completed if energy savings resulting from the EPIA will be included as part of reporting energy savings using a bottom-up approach. If this is the case the requirements of this M&V Guide shall be followed when calculating EPIA energy savings. Otherwise, the results section may optionally be completed or fields left blank.

The Opportunity Register may include additional sections and fields as suggested by the PA, implementer, and customer.

5.3.2 Planning to Collect Data for EPIAs

The Opportunity Register shall be filled out as part of a PA sponsored SEM program regardless if a top-down or bottom-up method will be used to determine energy savings. Guidance on calculating energy savings for individual EPIAs are listed in Annex D – Bottom Up EPIA Calculation Effort and should be consulted when planning for data collection to determine the results of implemented EPIAs if the energy savings for the EPIA will be included as part of reporting energy savings using the bottom-up method.

5.4 Customer Learning and Leading

SEM Program Cycle 1: The implementer should lead the process of developing the Energy Data Collection Plan with input from the customer. The customer should understand the requirements of the plan and who will obtain what data.

SEM Program Cycle 2: The implementer should lead the review and update of the Energy Data Collection Plan with equal participation from the customer. The customer should fully

910 understand how the plan was developed and what changes at the facility may lead to the plan
911 needing to be updated.

912 **SEM Program Cycle 3:** The customer should lead review and update of the Energy Data
913 Collection Plan with support from the implementer. The implementer should ensure the
914 requirements of this M&V Guide are met.

915

916

6 Collecting Data and Assessing Data Quality

Energy data collection shall be conducted regardless of if an energy consumption adjustment model can or will be developed. Collected data may be used later if operations or other factors change as that data provides information about site operations in relationship to the energy management system and captures results of implemented EPIA.

The Energy Data Collection Plan shall be continuously used to guide the collection of energy consumption and relevant variable data in the Energy Data and Performance Tracking Tool. The customer shall ensure that data needed to calculate energy savings for implemented EPIAs listed on the Opportunity Register are collected as needed. Data pertaining to specific EPIAs do not necessarily need to be tracked in the Energy Data and Performance Tracking Tool. The collection, recording, and maintenance of data shall be led by the customer.

6.1 Collecting Data

The implementer shall ensure that data are being collected in accordance with the Energy Data Collection Plan on at least a monthly basis to ensure that data are being accurately collected and recorded.

Energy data shall be recorded in the Energy Data and Performance Tracking Tool. Raw source data shall be preserved along with modifications made to data. Data continuity is critical to maintaining energy consumption adjustment model accuracy through the SEM program engagement.

As data are collected, issues that arise with implementing the Energy Data Collection Plan shall be documented and used to assess if modifications to the Energy Data Collection Plan are needed.

6.2 Reviewing for Data Outliers and Missing Data Points

Data outliers and missing data points can negatively impact the accuracy of energy consumption adjustment models.

Data outliers and missing data points shall be identified and addressed.

Energy consumption and relevant variable data shall be screened for anomalous values that are not representative of typical operating conditions. If high variability is characteristic of the operation, outliers do not necessarily need to be removed. Data outliers can be an indicator of poor operational control and can be used to help identify possible energy performance improvement actions. The effect of outliers on the reliability of energy consumption adjustment models and the reason for removing them shall be maintained as a record.

If an anomalous value is found, reasons for the anomaly shall be identified if possible. If the anomaly is determined to be a data error, the error shall be corrected if possible. If the anomaly is determined to be a data error that cannot be corrected, the anomalous value shall be deleted from the data set. The effects of data errors on the reliability of the energy consumption adjustment model and the reason for making any changes to the data set shall be maintained as a record. If the anomalous value is determined not to be a data error it shall be left in the data set.

An initial review for outliers and missing data can be conducted by creating time series plots of data for energy consumption and relevant variable independently in a time series format. Outliers and missing or erroneous entries shall be flagged for review, investigation, and correction (if possible) by applying a general rule for identifying data that lie outside the range of plus or minus three standard deviations from the mean.

A resolution strategy shall be developed for identified outliers. Regardless of rational or explanation, data outliers beyond the plus or minus three standard deviations from the mean

may be omitted. If outliers related to specific operating conditions are excluded from the Baseline Period, the intervals in the Reporting Period corresponding to the same conditions must also be excluded from the Reporting Period. The strategy used to remove outliers shall be documented.

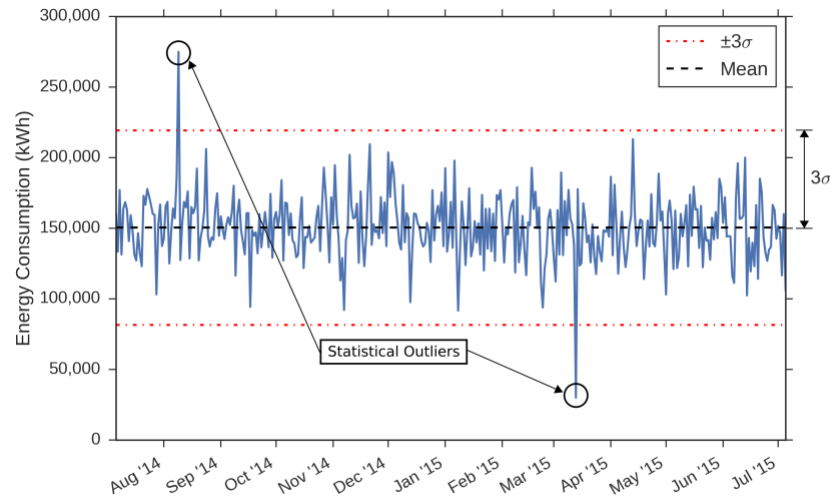


Figure 2. Example of Graphical Methods to Identify Outliers.

Omitted data shall not be replaced with a calculated interpolation. Filling in missing data can skew energy consumption adjustment model validity.

NOTE: A particular type of outlier results from shut-down periods where production is zero. In some facilities, this may only occur for a handful of days per year. If a single energy consumption adjustment model can be created that reflects both the production and non-production days, the shut-down outliers do not need to be excluded. Alternatively, a relevant variable can be created to account for the effect of reoccurring shutdown days. If an otherwise valid adjustment model cannot be created to accommodate the shut-down periods, these periods may be excluded from the model or treated as a separate mode of operation and modeled independently. When determining a strategy, consider whether energy savings are expected to be achieved during shutdown periods.

NOTE: Outliers should not be excluded from data sets unless there is a reason to do so. For example, a site may have outliers on major holidays. Consider adding an indicator variable to represent those holidays, or simply exclude these holidays from the model. Note that any reoccurring periods that are excluded from the baseline model must also be excluded from the Reporting Period.

NOTE: Be careful to distinguish between a zero-data point and a missing data point. Missing data should be excluded and not treated as a zero.

NOTE: The removal of outliers, especially in the cases when data is collected on a monthly basis, can significantly affect an energy consumption model's predictive power. Careful consideration should be made regarding the removal of outliers when data is collected on a less frequent basis.

Outliers shall be reviewed by the customer and implementer so that both parties understand the cause of the anomaly. The customer shall take corrective action to reduce the potential for data

outliers if possible as outliers can be an indicator of poor operational control or data collection systems. The omission of data points shall be documented.

6.3 Adjusting Data for Time-Series Offsets

Energy consumption and relevant variable data will frequently not be available for exact calendar months or aligned with other time intervals. For example, monthly production data may be reported on the first of the month, while utility data may be provided mid-month. Alignment of time intervals is preferred and may facilitate development of more representative adjustment models, but it is not required.

A time-series offset may exist between energy consumption and relevant variable data. Energy consumption and relevant variable data shall be reviewed to identify time-series offsets. This most commonly occurs when data are collected at high frequency levels (typically weekly or higher). Time-series offsets that negatively affect adjustment model development shall not be used.

Time-series plots shall be used to identify consistent offsets between energy consumption data and each relevant variable. For example, if an energy-intensive process has a two-day lead time from the point at which production levels are measured, a two-day time series adjustment may need to be applied to the production variable.

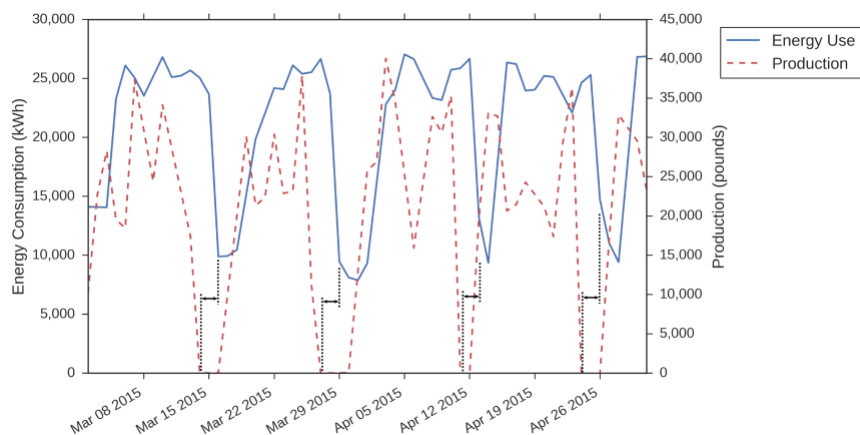


Figure 3. Example of a Time-series Plot (Energy Consumption and Production vs. Time). Arrows Indicate the Time-series Offset.

If such an offset is identified, the customer and implementer shall discuss if the application of a time-series adjustment, or if aggregating data such that the data frequency interval is lower (e.g. aggregate so that all data are represented on a weekly rather than daily time interval), would improve the adjustment model. The decision to use a time-series adjustment shall be documented.

As part of an PA sponsored SEM program engagement, data collected on a monthly basis or irregular time intervals (such as billing cycles roughly issued on a monthly basis) shall be weighted based upon the number of days in the month the data were collected. Weighting should be based upon the number of days within the month or irregular time interval. These weighted values should be recorded alongside the original values and weighting value.

6.4 Customer Learning and Leading

SEM Program Cycle 1: The implementer leads the development of the Energy Data Collection Plan. The customer will provide input and needs to understand and buy into ensuring the Energy Data Collection Plan is implemented with their staff collecting and reporting data as specified.

1029 **SEM Program Cycle 2:** The implementer leads the process of updating the Energy Data
1030 Collection Plan working closely with the customer. The customer should be able to provide
1031 feedback on the effectiveness of the Energy Data Collection Plan. The updated plan should
1032 have an increased reliance on customer staff to collect energy and relevant variable data rather
1033 than data being provided by the PA or collected by the implementer.

1034 **SEM Program Cycle 3:** The customer should lead the process of updating the Energy Data
1035 Collection Plan with support from the implementer. The Energy Data Collection Plan should rely
1036 on the customer collecting and maintaining energy and relevant variable data.

7 Energy Consumption Adjustment Modeling

7.1 Introduction

The primary method for determining energy savings shall be to develop and use one or more energy consumption adjustment models for each type of energy identified in Section 3.1

To aid in the customer's understanding of their site and ability to develop energy consumption adjustment models, the implementer shall strive to develop simple and easily understood models rather than complex models that may statistically be more precise. Multiple energy consumption adjustment models for a specific type of energy may be needed to achieve this simplicity principle.

While a number of energy consumption adjustment modeling methods exist, the forecast method shall be used if energy consumption adjustment models are to be developed as part of a PA sponsored SEM Program Cycle as it meets all of the goals and objectives identified in this M&V Guide.

The forecast energy consumption adjustment model method allows the model user to estimate what Reporting Period energy consumption would have been if the site had not implemented any EPIAs during the Reporting Period and operated as it did during the Baseline Period.

The forecast method provides a predictive energy consumption adjustment model that once developed can be used to track energy performance and routinely determine energy savings.

The forecast model can also be used to project energy demand if future relevant variable quantities, such as production volume, are known.

Alternative modeling methods do not necessarily meet all of the objectives for energy consumption adjustment models identified in this M&V Guide and do not necessarily offer an opportunity for immediate customer education and ability to respond to unexpected model results.

This M&V Guide acknowledges that the forecast model method does have limitations, particularly if site energy use and operating conditions change significantly during the Reporting Period. If forecast models cannot be developed for a given type of energy then the implementer may use the backcast model method for the purposes of regulatory reporting of energy savings. Only the backcast model method is provided as an alternative in this M&V Guide. This limitation is intentional as to deter excess expenditure or resources to develop any working energy consumption adjustment model and help ensure the focus of the M&V process remains on customer education and building systems that the customer can use on their own in the future.

7.2 Assessing if Modeling Should be Attempted

An assessment of the site and customer should be made to determine if the process of energy consumption adjustment modeling should be undertaken.

The following are non-exhaustive lists of potential indicators that either energy consumption modeling efforts should not be made, that additional review and scrutiny should be placed on models as they may not be able to be used to calculate valid energy savings, or that energy models should be abandoned mid Reporting Period. Regardless of the following being true for a customer, the implementer may wish to attempt to develop energy consumption adjustment models.

Before or at the beginning of engagement in the SEM Program:

- Estimated site wide energy savings potential is less than 1% of annual site energy consumption or less than 100,000 kWh of electricity per year or 20,000 therms per year.

- 1081 • Major site, production, or schedule changes have occurred in the past year or are
1082 planned in the next year.
- 1083 • Site energy consumption is increasing at a rate greater than a few percent per year.
- 1084 • EPIAs with greater than 5% of a baseline energy consumption have been identified and
1085 planned for implementation by the customer prior to the engagement in the SEM
1086 program and will be implemented in the Baseline Period or during engagement in the
1087 SEM Program.
- 1088 • Highly variable production, production cycles longer than a month, or seasonal
1089 production are observed.
- 1090 • On-site energy generation isn't metered.
- 1091 • More than 10 energy meters for a given type of energy are identified.

1092 During engagement in the SEM Program:

- 1093 • Energy and relevant variable data are not being collected and site staff are not indicating
1094 interest in correcting this issue.
- 1095 • Energy and relevant variable data are recorded in a format that will require excessive
1096 time to process (e.g., PDF, manual logging sheets).
- 1097 • Energy data quality is poor (e.g., missing intervals, multiple data points appear to be
1098 erroneous, interval data isn't consistent with billing data).
- 1099 • Relevant variable data quality is poor (e.g., significant missing intervals, multiple data
1100 points appear to be erroneous).

1101 The decision and rationale to not start or not continue energy consumption adjustment model
1102 development shall be documented in a "Notification of Bottom-up Method of Determining Energy
1103 Savings," summary and submitted to the PA for their review and approval. The Notification of
1104 Bottom-up Method of Determining Energy Savings summary shall contain:

- 1105 • Statement describing efforts taken to-date to create energy consumption adjustment
1106 models.
- 1107 • Justification for not further pursuing energy consumption adjustment models and
1108 switching to the bottom-up approach.
- 1109 • Discussion of what efforts can and will be taken to enable the development of energy
1110 consumption adjustment models in subsequent Reporting Periods.

1111 The Notification of Bottom-up Method of Determining Energy Savings summary shall only be
1112 valid for the current Reporting Period. A new summary shall be needed for each subsequent
1113 Reporting Period if the bottom-up method shall be requested for those Reporting Periods,
1114 otherwise the assumption will be made that an energy consumption adjustment model will be
1115 developed.

1116 **7.3 Process**

1117 Development of one or more energy consumption adjustment models for each energy type shall
1118 be considered with the following process:

- 1119 1. Establish the relationship of relevant variables to energy consumption.
- 1120 2. Establish Energy Baseline.
- 1121 3. Develop energy consumption adjustment models.
- 1122 4. Review competing energy consumption adjustment models.
- 1123 5. Select energy consumption adjustment models for use to track energy performance and
1124 calculate energy savings.

7.4 Considerations when Developing Energy Consumption Adjustment Models with Data from Multiple Meters

When developing energy consumption adjustment models and energy data for a given type of energy is available from multiple meters, one of the following options shall be followed:

- Aggregate energy data. Sum the data from two or more meters to create an aggregate of site energy data. If meter data is collected at different intervals, aggregate to the largest sampling interval. This method is appropriate when:
 - Meters have the same interval, or the meter capturing the greatest energy consumption has the largest sampling interval.
 - The same relevant variables apply to all meters.
 - The resulting energy consumption adjustment model created by using the aggregate data is simple and meaningful.
- Build separate energy consumption adjustment models. Build an individual energy consumption adjustment model for each meter. Energy savings calculated for each model will be aggregated. Multiple models for a given type of energy may be created so long as the boundaries of each model do not overlap with one another and fit within the larger M&V boundary. Each model must meet the requirements of Sections 7.8.2 and 7.8.3. This method is appropriate when:
 - An aggregate energy consumption adjustment model will have a large number of relevant variables.
 - Meters serve different areas or processes with different relevant variables.
 - Meters have different measurement intervals, especially if a meter with the largest energy consumption has much finer granularity than the other meter(s).
 - The customer prefers separate models for greater context of energy performance tracking and energy savings.
- Ignore meters. If the loads connected to a meter are outside the M&V boundaries or are used to meter negligible portion of a given type of energy (approximately less than 2% of site energy baseline energy consumption for a given type of energy), exclude these meters.

7.5 Establishing Relationships Between Energy Consumption and Relevant Variables

Energy consumption adjustment models shall be created based upon an informed understanding of the characteristics of the equipment, operations, and processes present within the M&V boundaries. To establish the relationship between energy consumption and relevant variables the following guidance shall be followed appropriately:

7.5.1 Confirming a Relationship

Use scatter diagrams to visually confirm whether a linear relationship exists between energy consumption data for each type of energy for which energy savings are being determined and each relevant variable.

Though not statistically tested at this point, a lack of relationship between energy consumption and a relevant variable for which a relationship was expected shall prompt a discussion between the customer and implementer. This result may be due to poor operational control or a mischaracterization of the site.

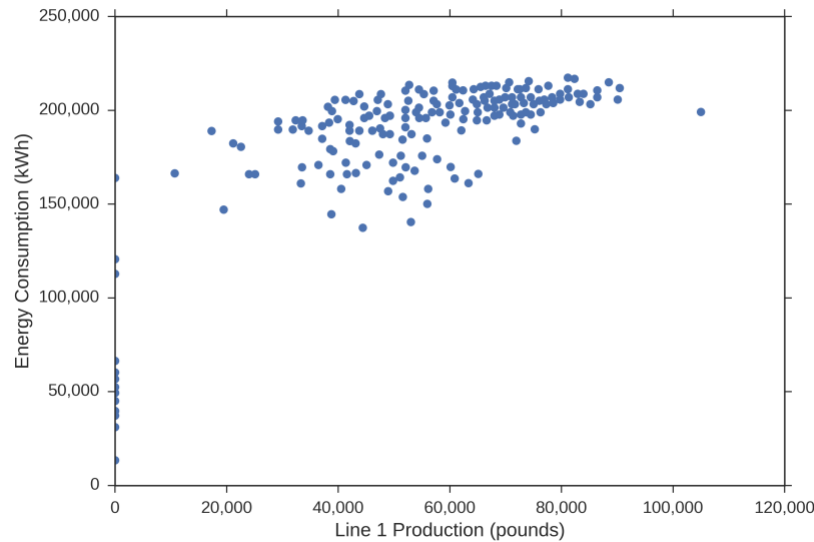


Figure 4. Example of a Scatter Plot (Energy Consumption vs. Production).

7.5.2 Change-point Variables

Sites may have operational conditions related to energy consumption that change at some value of that variable. A common example is of sites that have an ambient-dependent energy profile which will often exhibit a “change-point” characteristic. The presence of a “change-point” can be determined by plotting a relevant variable versus energy consumption. Modeling a site that exhibits a change-point with a single linear model introduces unnecessary error. Alternative relevant variables or a Multi-Mode Model shall be considered if a change-point is observed.

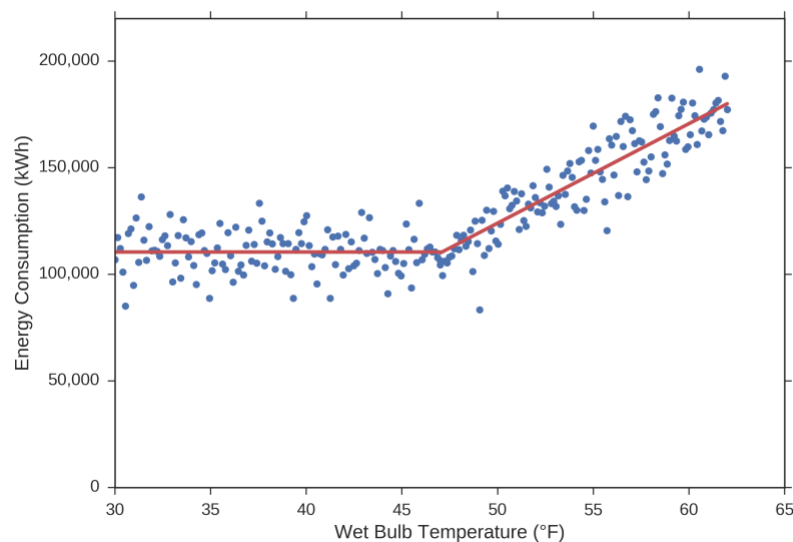


Figure 5. Example of a Change-point.

7.5.3 Multicollinearity

When two or more relevant variables exhibit correlation for the same energy type, multicollinearity is present. Adding and removing variables from the adjustment model will affect the significance of other variables. The presence of collinear variables can understate the

statistical significance of individual relevant variables. Although in many cases multicollinearity is unavoidable, it reduces the ability of statistical tests to establish model validity. While multicollinearity does not affect the model's predictive capacity, it has the potential to add unnecessary complexity. Multicollinearity shall be minimized if possible. See Annex E – Multicollinearity and Autocorrelation, for a discussion on the effect of multicollinearity on an adjustment model.

7.5.4 Weather Variables

Weather can be represented in terms of a number of variables including average temperature, solar radiation, rainfall humidity, wet-bulb temperature, CDD and HDD, etc.. When developing energy consumption adjustment models both approaches should be examined. For weekly and monthly models, a CDD/HDD model is preferred because it better represents heating and cooling demands over an aggregate period. For daily models, a CDD/HDD model is functionally equivalent to an average temperature model with a change point.

Weather correlation often masks other seasonal changes. Judgment and knowledge about the site and its equipment should be used to determine whether energy consumption is truly affected by ambient weather. If no justification exists for a weather correlation, identify a more appropriate relevant variable to characterize the seasonal changes.

7.6 Establishing Energy Baseline

Pursuant to CPUC Decision 16-08-019, SEM uses an “existing baseline condition” basis for determining energy savings. As such, the energy baseline naturally accounts for a site's compliance with code and local regulation and any program influenced improvements in energy efficiency shall be claimed and attributed to the SEM program. Past practices, code compliance, regulatory maintenance, permitting and operations (whether good or bad) are included in the energy baseline.

While the energy baseline is an existing conditions baseline, certain EPIAs and non-routine events that may have taken place during the Baseline Period need to be removed from the energy baseline to establish a clear understanding of the relationship of energy consumption to relevant variables prior to the time periods for which an energy consumption adjustment model will be used.

In order to create energy consumption adjustment models that reflect regular site operations, customer and PA records shall be reviewed to determine if any incentivized or non-incentivized EPIAs with sizable energy savings were implemented during the Baseline Period. In addition to reviewing customer records, interviews with customer staff shall be conducted to determine if other non-incentivized EPIAs or changes that increased energy consumption occurred. If the customer had previously participated in a PA sponsored SEM Program Cycle the Opportunity Register should be a continuation from that prior engagement and shall be reviewed for implemented EPIAs.

If such EPIAs were implemented during the Baseline Period, project records shall be obtained to accurately capture implementation dates and the magnitude of verified savings as needed. Ensure these EPIAs are documented on the Opportunity Register.

If EPIAs implemented during the Baseline Period are identified, consider modifying the Baseline Period to a time period when the EPIA was not implemented. If the EPIA was implemented after the Baseline Period and prior to the start of the SEM Engagement Period adjust the baseline to account for the EPIA.

If the Baseline Period includes implemented EPIAs, confirm whether the PA does or does not have approved annualized energy savings values for the EPIA. Approved energy savings values shall be used for any adjustment made because of the EPIA. If the PA approved energy

1230 savings values are not available, calculate energy savings for the EPIA following the
 1231 requirements of this M&V Guide (see Section 8.2.1).

1232 Use prorated energy savings values to adjust the energy consumption of the Energy Baseline
 1233 using PA approved energy savings values if they are available. Prorating of energy savings
 1234 should be based upon the EPIA implementation date. Confirm the implementation date
 1235 recorded by the PA, if available, against the records and memory of site staff. Use the
 1236 implementation date that best connects to when energy savings resulting from the EPIA would
 1237 have been realized.

1238 EPIAs that are known to have a seasonal nature can be removed from the energy baseline
 1239 accounting for known seasonality.

1240 **7.7 Developing Energy Consumption Adjustment Models**

1241 Using information gathered as part of the M&V process, for each energy type for which data are
 1242 collected, develop one or more energy consumption adjustment models with the form:

1243
$$\text{Energy Consumption} = b_0 + b_i x_i + b_{i+1} x_{i+1} + \dots + b_n x_n$$

1244 with i from 1 to n representing the number of relevant variables used in the energy consumption
 1245 adjustment model and where x_i is the relevant variable quantity, b_0 is the base load delivered
 1246 energy consumption not related to relevant variables, and b_i (when $i > 0$) is the incremental
 1247 energy consumption per unit of that relevant variable (coefficient).

1248 Attempts shall be made to develop one or more energy consumption adjustment models for
 1249 each energy type in order to capture the full M&V boundary as best possible. If development of
 1250 models to encompass the full M&V boundary is not possible then developing multiple energy
 1251 consumption models that “fit” within the M&V boundary shall be attempted.

1252 Depending on the list of selected relevant variables identified in the Energy Data Collection Plan
 1253 for which data were collected, attempts shall be made to develop competing models that can be
 1254 assessed with the quantitative and qualitative validity tests described in the energy consumption
 1255 adjustment model validity section (7.8) of this M&V Guide.

1256 **7.7.1 Simplicity principal**

1257 The desire to create the most descriptive or “perfect” model can lead to a disproportionate use
 1258 of resources. The objectives of creating energy consumption models extend beyond creating
 1259 tools to estimate site-wide energy savings.

1260 Simple energy consumption adjustment models have multiple benefits:

- 1261 • Easier data collection: In some cases, collecting production data may be a burden to the
 1262 customer. Minimizing the data requirements for a customer may increase buy-in to data
 1263 collection and use of the energy consumption adjustment models.
- 1264 • Better understanding of the model: A model that can be easily explained will be better
 1265 understood by the customer, which will increase their trust in the energy savings
 1266 predicted by the final model.
- 1267 • Reduced likelihood of outliers and errors: A model with fewer variables is less likely to
 1268 suffer from data-entry errors and/or outliers during the Reporting Period. A simple model
 1269 is more “durable” and therefore more useful to a customer long-term.

1270 Customers need to be able to understand the modeling process and outputs so they can track
 1271 energy performance and determine energy performance improvement using the model.
 1272 Creating simple models that are easily understood in their relationship of energy consumption
 1273 and relevant variables will assist in this understanding.

As guidance, if the number of relevant variables are being used in a single energy consumption adjustment model is greater than the number of energy baseline period intervals divided by six the modeler should consider options to simplify the model. However, also consider that an energy consumption adjustment model which is too simple and does not include sufficient relevant variables can provide poor predictive capability. Weigh the pros and cons of each combination of variables to determine a minimal level of model complexity while providing adequate energy savings estimations.

7.7.2 Frequency of Data used to Create Models

When possible, use daily intervals to develop energy consumption adjustment models. Models based on daily data allows the customer to track energy performance frequently during the SEM Program Cycle and can improve overall model accuracy by increasing the number of Baseline and Reporting Period data points. Meter data can often be acquired in 15-minute intervals and summed into daily energy data. The frequency of energy data will need to match that of relevant variable data.

If a multi-day time-shift exists between energy consumption and the primary production relevant variable, consider using weekly model rather than a daily model.

If daily production or other relevant variable data is not available, weekly or monthly model intervals can be used. Weekly model intervals are preferred over monthly. Ensure that energy consumption data is accurately summed to match relevant variable intervals.

7.8 Reviewing Competing Energy Consumption Adjustment Models

7.8.1 Assessing Statistical Significance of Relevant Variables

To establish quantitative validity, each relevant variable used in an energy consumption adjustment model shall meet all of the following statistical tests:

Statistical Tests	Statistical Test Threshold Values
T-stat	Absolute value > 2.00
p-value	< 0.05

Table 2: Relevant Variable Statistical Tests

Adding and removing relevant variables will affect the significance of other relevant variables. In many cases, multicollinearity is unavoidable; however, multicollinearity should be taken into consideration when validating the statistical significance of each relevant variable. While multicollinearity does not affect the model's predictive capacity, it has the potential to add unnecessary complexity. See Annex E – Multicollinearity and Autocorrelation, for more information.

7.8.2 Validating Models with Statistical Tests

The following statistical tests shall be applied to all energy consumption adjustment models:

Statistical Tests	Statistical Test Threshold Values
Number of Relevant Variables	< 5
Model R ²	> 0.75
Net Determination Bias	< 0.005%
Coefficient of Variation	< 20% for daily models
	< 10% for weekly models
	< 5% for monthly models
Durbin-Watson	~ 2
Fractional Savings Uncertainty (predictive)	< 50% Apply roughly estimated energy savings and Reporting Period interval frequency.

Table 3: Energy Consumption Statistical Tests

7.8.3 Validating Models with Qualitative Considerations

As energy consumption adjustment models shall be only used to calculate energy savings if the model meaningfully represents the site's relationship of energy consumption to relevant variables.

Equal to the statistical validity tests, the selection of energy consumption models shall be based upon assessment of qualitative considerations, including that:

- The model when applied to Baseline Period appears to produce a stable and near zero savings result.
- The selection of relevant variables in the adjustment model and the subsequently determined relevant variable coefficients are consistent with a logical understanding of the energy use and energy consumption of the site.
- Meters used were functioning, calibrated, and maintained as appropriate.

Additionally, considerations including the simplicity of the energy consumption adjustment model, meaning of the model to the customer, and the ability to continue collecting data required for use of the model shall be considered.

7.8.4 Table of Competing Models

In order to demonstrate the effort and process followed to develop and select meaningful energy consumption adjustment models a description of the modeling down selection process and a table of competing models shall be created for each energy consumption adjustment model developed. The model down selection process and table of competing models shall be provided during the Mid-Year Review and documented in the SEM Reporting Period Performance Report.

The description of the modeling down selection process shall include:

- The number of models developed and assessed.
- The number of models that met more than 50% of the statistical tests identified in Section 7.8.2.
- The number of model that were considered for use and the qualitative assessment applied.
- A statement of the quantitative and qualitative reasons why the model selected for use was chosen over others.

The table of competing models shall include at most three of the most meaningful energy consumption adjustment models that were considered with both quantitative and qualitative assessment but not selected for use. The table shall include a row for each competing model and a column for each of the following:

- Model reference number.
- Data interval (frequency).
- Baseline Period start and end dates.
- Upcoming Reporting Period start and end dates.
- R^2 .
- Net determination bias.
- Coefficient of variation.
- Durbin Watson.
- Projected fractional savings uncertainty.
- Comments about the model.

1351 Four columns of each row should be subdivided to provide information about the relevant
1352 variables that are used to form the model. The four columns should include:

- 1353 • Name of the relevant variable.
- 1354 • Relevant variable coefficient value.
- 1355 • T-stat.
- 1356 • P-value.

1357 An example showing the graphical layout of the table of competing models is provided in Annex
1358 F – Graphical Representation of the Table of Competing Models.

1359 The table of competing models shall be filled out as the energy consumption adjustment
1360 modeling development effort proceeds.

1361 **7.9 Selecting Energy Consumption Adjustment Models to Track Energy Performance** 1362 **and Calculate Energy Savings**

1363 The selection of energy consumption adjustment models that will be used to track energy
1364 performance and determine energy performance improvement shall be made based upon
1365 quantitative and qualitative model validity testing described in this M&V Guide.

1366 The table of competing models should be used along with qualitative assessments to select
1367 energy consumption adjustment models that will be used to track energy performance and
1368 calculate energy savings.

1369 The selection of energy consumption adjustment models should not be narrowly driven by
1370 evaluating which model “best” meets statistical tests as meaningful models may not meet all
1371 listed statistical tests. For example, a low R^2 value may be the result for a site with low variation
1372 in energy consumption. In cases where all of the tests cannot be met but a model passes a
1373 majority of the statistical tests and meets the qualitative requirements of Section 7.8.3, the
1374 customer and implementer together shall select which models to use moving forward. The
1375 energy consumption adjustment model selection rationale shall be documented.

1376 **7.10 Ongoing Confirmation of Model Validity**

1377 It is recommended, but not required, that on at least quarterly basis confirmation of model
1378 validity be reviewed with the customer.

1379 If conducted ,ongoing confirmation of model validity should include answering the following
1380 questions:

- 1381 • Have operating characteristics dramatically changed?
- 1382 • Has production or other relevant variable values changed to they are outside the range
1383 as recorded during the Baseline Period?
- 1384 • Have any major energy uses been installed or removed?
- 1385 • Does the level of energy savings achieved so far not reasonably align with energy
1386 savings from implemented EPIAs listed on the Opportunity Register?
- 1387 • Have the site or M&V boundaries changed?

1388 If any of the above questions are answered, “yes,” then the quantitative and qualitative validity
1389 of the model should be confirmed. If the model cannot be confirmed as valid options listed in
1390 Section 7.11 shall be considered.

1391 Data collected for use with the selected energy consumption adjustment model shall be
1392 analyzed as well. Individual data intervals in the Reporting Period should be flagged as an
1393 outlier if a relevant variable data point is $\pm 10\%$ beyond the bounds of the energy baseline data
1394 set. These points may be handled in one of three ways:

- Include the point without alteration.
 - This is appropriate if a representative population of residuals (defined by the implementer) for the point is not an outlier (plus or minus three standard deviations from the mean of Reporting Period data) compared to the overall population of residuals.
- Exclude the point.
 - This is appropriate if a representative population of residuals (defined by the implementer) of the outlier point (plus or minus three standard deviations from the mean of Reporting Period data) is an outlier compared to the overall population of residuals. In this case the energy savings from this outlier point would have an outsized effect on the energy savings measurement.
- Develop a new energy consumption adjustment model.
 - This is appropriate if the outlier interval data points (plus or minus three standard deviations from the mean of Reporting Period data) are caused by an issue that will fundamentally result in an energy consumption adjustment model that does not have a meaningful relationship to the energy consumption, uses, and operations of the site.

7.11 Options when a Valid Energy Consumption Adjustment Model Cannot be Created or Models in use Fail Validity Tests

Energy consumption adjustment models that do not meet the model selection requirements of Section 7.9 cannot be used in the calculation of energy savings as part of a PA sponsored SEM program and may potentially mislead customers. This applies to models being newly developed and models that have been used in the past.

If such a case occurs, the party responsible for developing energy consumption adjustment models shall first attempt to modify the forecast adjustment model. This process might include modifications to the assumed relevant variables and frequency of data collection. Any changes that result in a successful energy consumption adjustment model shall be noted in the Energy

Changes to the Baseline Period are allowed as detailed in Section 2.1.3 but are not recommended. The objective of the M&V process is not to hunt for a valid model but to collect data and assess if a model can be made to meaningfully represent the relationship of energy consumption to relevant variables.

The below sections provide guidance when the development of an energy consumption adjustment model is not successful.

7.11.1.1 Non-Routine Adjustments to the Baseline Energy Consumption

Non-routine adjustments (NRA) are made to the observed (actual) energy consumption in the baseline and/or Reporting Periods if one or both of the following non-routine events (NRE) have occurred:

1. If static factors have changed during the Reporting Period.
2. If relevant variables have been subject to unusual changes.

Examples of events that might require a non-routine adjustment include the following:

- A supplier goes out of business, and an equivalent raw material is not available. A process modification is needed to use a different type of raw material. No data exist for Baseline Period operating conditions with the new type of raw material.
- Processes are outsourced, enhancing profitability and decreasing energy consumption.
- Business acquisition occurs which results in data not being available or in limits on the data available for the period prior to the acquisition.

1441 • A piece of equipment becomes inoperable and is replaced with a temporary piece of
 1442 equipment that consumes a different type of energy (e.g. air compressor or chiller
 1443 replaced by a diesel-powered rental).
 1444 • A process is temporarily outsource to another site or supplier.

1445 NREs can be detected through human feedback or statistical approaches. Site staff may be
 1446 aware of changes to equipment, system, and processes that would cause a NRE. Manual
 1447 identification of NREs relies on site staff knowledge of normal and abnormal operations which
 1448 may cause some NREs to go undetected. Site staff knowledge of NREs shall be supported by
 1449 statistical and other appropriate analysis.

1450 NRE identification shall be supported by statistical or other quantified analysis. Any numeric
 1451 inputs to non-routine adjustment calculations shall be based on observed, measured, or
 1452 metered data.

1453 Examples of statistical and other quantified analysis approaches to NRE identification can be
 1454 found in EVO' *IPMVP Application Guide on Non-routine Events & Adjustments*³ publication and
 1455 the 2020 ECEEE conference paper *Non-routing adjustments – towards standardizing M&V*
 1456 *approach for quantifying the effects of static factors*.⁴

1457 The effort expended to calculate the amount of energy the non-routine adjustment will result in
 1458 should be proportional to the level of expected energy adjustment and be in line with the
 1459 guidance of Annex D – Bottom Up EPIA Calculation Effort.

1460 The method for identifying and making the NRAs and the rationale for that method shall be
 1461 maintained, including a start and end date, why they are "non-routine," the general
 1462 reasonableness of the methodology and calculations, the adequacy of the metering and
 1463 monitoring methodologies, and conformance of the calculations applied. All calculations and
 1464 data processing shall be transparent and retained within the model files and in other
 1465 documentation as required in the M&V Guide and by the PA.

1466 If an open-ended non-routine event is specified, the documentation shall state clear conditions
 1467 for how and when to re-evaluate ending the adjustment. For example, if an air compressor fails
 1468 and a backup unit is in place, the condition would be the repair of the air compressor, and
 1469 shutdown of the backup unit would end the non-routine event.

1470 NRAs shall only be used after review and approval from the PA. The method for making the
 1471 non-routine adjustment and the rationale for that method shall be documented.

1472 *7.11.1.2 Factoring for Seasonality*

1473 Many sites experience seasonal swings in operation. Swings can occur because of seasonal
 1474 changes in product type, product quantity, or correlations between ambient temperature and
 1475 process loads. When operational swings cause a fundamental change in the energy
 1476 consumption of a site, consider building multiple models if a single model is unable to
 1477 adequately capture the seasonal variations.

1478 If seasonal changes are moderate and gradual, a single model may be sufficient to characterize
 1479 the entire energy baseline.

1480 If a site has a short period of abnormally high or low production with a different energy
 1481 signature, or a negligible number of shutdown days throughout the year, consider removing
 1482 these periods in the Baseline and Reporting Period as outliers.

³ Efficiency Valuation Organization (EVO), IPMVP Application Guide on Non-routine Events & Adjustments, 2020

⁴ Earni, S. and Therkelsen, P., Non-routing adjustments – towards standardizing M&V approach for quantifying the effects of static factors. 2020. Presented at the ECEEE Industrial Summer Study, virtual event, DOI 10.20357/B71W20

1483 If seasonal changes are abrupt and extreme, consider creating a model that includes a
 1484 production based relevant variable and another model that does not.

1485 *7.11.1.3 Multiple models*

1486 If the M&V boundary is supplied by multiple meters, disaggregating the meters may result in
 1487 better model resolution.

1488 Sites experiencing swings due to weekend shutdowns are best modeled as one model with
 1489 Saturday/Sunday/weekend indicator variables for simplicity.

1490 Table 4**Error! Reference source not found.** is non exhaustive but outlines the pros and cons
 1491 for building one model versus two models in certin circumstances.

Strategy	Pros	Cons
Single model with assumed year-round savings	Captures savings at all intervals. Easier to maintain one model than two. Most straightforward method, if energy consumption stays consistent.	Periods with abnormally high or low production can skew the model. Seasonal production relevant variables can lead to complex models with many relevant variables.
Single model with abnormally high or low production periods removed	Improves model accuracy during normal production periods. Works well if energy efficiency opportunities are minimal during excluded periods.	Reduces number of baseline data points. Unknown number of future data points due to production changes.
Dual production/non-production model	Each model has fewer variables and is easier to understand. Can improve model fitness compared to single model.	Maintenance of two models. Reduces number of baseline data points for each model.

Table 4: Options for Modeling for sites with Production Swings

1492

1493 Models that exclude a signigicant operation model are not acceptable in general. If a model
 1494 excludes shut down times or other period of low consumption and operation this is acceptable. If
 1495 a model was to exclude certain product lines or other energy consuming operations arbitrarily
 1496 this is not acceptable.

1497 The requirements of Sections 7.4 and 7.9 shall be followed when creating multiple models.

1498 *7.11.1.4 Backcast Energy Consumption Adjustment Model Development Method*

1499 If forecast energy consumption adjustment models still cannot be created, use of the backcast
 1500 method to develop energy consumption adjustment models can be considered. The
 1501 development of a backcast energy consumption model is optional. A bottom-up approach to
 1502 determining energy savings may be preferred. Rationale for the use of the backcast model over
 1503 reporting energy savings aggregated from implemented EPIAs must be supported, documented,
 1504 and accepted by the PA. Such rationale could include assumptions that significant energy
 1505 savings will be achieved from operational actions that would not be accounted for by the
 1506 aggregation of energy savings for EPIA listed on the Opportunity Register.

1507 Backcast normalization results in a model of the Reporting Period energy consumption that is
 1508 applied to the Baseline Period and Reporting Period-relevant variable values to calculate
 1509 adjusted Reporting Period energy consumption for comparison with observed (actual) Baseline
 1510 Period energy consumption. The adjusted Reporting Period energy consumption is an estimate
 1511 of the energy consumption that would have been expected at Baseline Period relevant variable

1512 values, if the Reporting Period operating systems and practices were in place during the
1513 Baseline Period.

1514 The backcast normalization method is applicable in instances where:

- 1515 • One or more relevant variables has significantly increased or decreased from the
1516 Baseline Period through the Reporting Period.
- 1517 • The resolution of the energy signature for the Baseline Period was relatively poor and
1518 the resolution of the energy signature during the Reporting Period has significantly
1519 improved.
- 1520 • No major operational or structural changes have occurred during the SEM Program
1521 Cycle.

1522 The backcast modeling method may be used so long as the validity requirements of Section 7.8
1523 are taken into account. The justification and use of a backcast modeling method shall be
1524 documented.

1525 *7.11.1.5 Pivot to a Bottom up Approach*

1526 If attempts to modify an invalid model are unsuccessful, and the model remains out of
1527 compliance with the majority of validity requirements in Section 7.8, and Section 7.10 the efforts
1528 to remedy the model should be documented in a Notification of Bottom-up Method of
1529 Determining Energy Savings (see Section 7.2), and the implementer should use the bottom-up
1530 methodology for estimating and reporting savings from implemented EPIAs.

1531 **7.12 Continued Use of Energy Baselines and Energy Consumption Adjustment** 1532 **Model(s)**

1533 Over the course of one or more SEM Program Cycles, changes to the operations, production, or
1534 equipment can invalidate energy consumption models. If during periodic checks or during the
1535 Mid-Year Review an energy consumption adjustment model is found to not be valid per the
1536 quantitative and qualitative tests in this M&V Guide, first examine if the model can be updated or
1537 if the energy baseline and energy consumption adjustment model are no longer viable.

1538 If the energy baseline is no longer viable or the existing energy consumption adjustment model
1539 becomes invalid, use of the energy consumption model shall be suspended and Section 7.11
1540 followed.

1541 An energy consumption adjustment model and its associated energy baseline that was
1542 approved for use during a previous Reporting Period may be accepted for continued use so
1543 long as all of the following are true:

- 1544 • The customer has continuously participated in a PA sponsored SEM Program Cycle
1545 since the original development of the energy consumption adjustment model (with an
1546 allowance for gaps between SEM Program Cycles resulting from cohort launch or other
1547 timing issues).
- 1548 • Energy saving values that were submitted and accepted by the CPUC for all Reporting
1549 Periods that preceded the current Reporting Period are available.
- 1550 • The energy consumption adjustment model and energy baseline data meet the
1551 quantitative and qualitative requirements of this M&V Guide.
- 1552 • An Opportunity Register originally developed as part of a prior SEM Program Cycle is
1553 available.
- 1554 • Relevant variables selected as part of the process detailed in Section 4 are not different
1555 than those used in the existing energy consumption adjustment model.
- 1556 • More granular energy consumption and relevant variable data are not available
1557 compared to those available when the existing energy consumption adjustment model
1558 was created.

- 1559 • The M&V boundaries have not changed.
- 1560 • The customer has not requested a new model.

1561 The above listed criteria shall be reviewed before continued use of existing energy consumption
1562 adjustment modes in a new Reporting Period. If following this review the energy consumption
1563 adjustment model is not found to be valid, the energy consumption adjustment model shall not
1564 be used and a new energy baseline and energy consumption adjustment model(s) shall be
1565 developed.

1566 The PA sponsoring the SEM program may at its discretion require a new Baseline Period,
1567 energy baseline, and energy consumption adjustment model development. This may be
1568 required at the beginning of new SEM Program Cycles to create a distinct basis for energy
1569 savings determination and to remove all residual effects of existing energy consumption
1570 adjustment models.

1571 **7.13 Customer Learning and Leading**

1572 The development of energy consumption adjustment models can be a complicated process and
1573 the implementer should work with the customer over multiple SEM Program Cycles to teach the
1574 customer how models are developed and maintained.

1575 This M&V Guide acknowledges the complexities and skill needed to develop energy
1576 consumption adjustment models, especially when they will be evaluated as part of regulatory
1577 oversight and potentially used to determine performance incentive payments.

1578 **SEM Program Cycle 1:** The implementer should develop energy consumption adjustment
1579 models and explain the concept of modeling and why the specific model was selected for the
1580 customer.

1581 **SEM Program Cycle 2:** The customer should be included as part of the review of energy
1582 consumption adjustment models and understand how to select one model over another.

1583 **SEM Program Cycle 3:** Review of energy consumption adjustment models may be led by the
1584 customer when their skills and abilities relative to the M&V process improve to an appropriate
1585 level with implementer support.

1586 During the third SEM Program Cycle the implementer shall ask the customer if they would like
1587 detailed instructions for energy consumption model management (e.g., energy data handling,
1588 unit conversions, time interval manipulations as well as customer provided data queries) to the
1589 customer in order for the customer to maintain use of the energy consumption adjustment
1590 model beyond participation in the PA sponsored SEM program. If the customer requests this
1591 instruction it shall be provided. The transfer of knowledge of energy consumption adjustment
1592 model development and maintenance should be documented.

1593

8 Monitoring Energy Performance

Energy performance should be monitored on a regular basis using the selected energy consumption adjustment models and the Opportunity Register.

This review is not intended to be a detailed evaluation to see if energy performance is as expected but allows for the identification of trends and decide if corrective actions need to be taken.

Backsliding refers to worsening energy performance compared to a previous achieved benchmark. Energy consumption adjustment models can be used to provide a feedback loop to identify and correct backsliding.

By reviewing if EPIAs are being implemented and generating expected energy saving and other results, the customer can ensure they are on track to meet energy performance targets and assess the effectiveness of their EnMS.

The review provides the implementer and customer a chance to ensure energy savings from implemented EPIAs are calculated with appropriate relative effort compared to an expected energy savings potential.

8.1 Tracking Energy Performance with Energy Consumption Adjustment Models

Data to be collected and captured by the Energy Performance Tracking Tool shall be updated with new data on at least a monthly basis.

The customer and implementer shall review the Energy Performance Tracking Tool on a regular basis to ensure data are being collected, energy performance is being calculated correctly, detect anomalous values, and account for situations not present in the Baseline Period that may need to be corrected for.

A time-series plot of actual and predicted energy consumption for each energy consumption model in use shall be created while tracking Energy Performance.

As new energy performance values are reviewed, an assessment to see if backsliding is occurring shall be performed. When backsliding is identified, corrective action shall be taken.

8.2 Tracking Energy Performance with the Opportunity Register

On a regular basis, the customer and implementer shall together review the Opportunity Register to ensure that EPIAs are being implemented. If EPIAs are not being implemented as anticipated an assessment of why they are not being implemented shall be conducted.

The implementer shall verify, at least quarterly, that the Opportunity Register is updated and maintained.

8.2.1 Calculating Annualized and Avoided Energy Consumption Energy Savings for EPIAs
Annualized and pro-rated energy savings for the Reporting Period (energy savings that would be realized in the Reporting Period based upon the EPIA implementation date) shall be determined after the action is implemented for each EPIA that will be included as part of the bottom-up based energy savings reporting.

In many cases, it will be difficult to assess the energy savings potential of BRO measures with accuracy.

M&V plans for each EPIA shall not be required as part of the calculation of EPIA energy savings.

If the customer will be applying for a custom capital or deemed incentive for a given EPIA listed on the Opportunity Register, the M&V practices governing those programs shall be followed.

1637 The energy savings value claimed as part of an incentivized project shall be recorded in the
 1638 Opportunity Register.

1639 If the EPIA listed on the Opportunity Register will not be used to apply for a custom capital or
 1640 deemed incentive, the effort expended to calculate energy savings for the EPIA shall be less
 1641 than that of incentivized custom capital project and proportional to the level of expected energy
 1642 savings. Annex D – Bottom Up EPIA Calculation Effort has more information on this topic.

1643 A required data point for each EPIA on the Opportunity Register is the EPIA implementation
 1644 date. This data shall be determined by the implementer in conversation with the customer using
 1645 reasonable considerations of the EPIA.

1646 The listed EPIA implementation date shall be used to delineate the temporal fraction of
 1647 annualized energy savings that will be prorated and attributed to the current Reporting Period.

1648 Prorated energy savings for each EPIA that annualized energy savings were calculated for shall
 1649 be determined based upon the listed implementation date and reasonable considerations such
 1650 as seasonality and a principle of simplicity.

1651 Energy savings calculations for EPIA shall be documented and defensible. Documentation of
 1652 the process used to determine EPIA energy savings does not have to be included in detail in the
 1653 Opportunity Register but shall be referenced and linked so the calculations can be easily found
 1654 using the EPIA identifiers listed on the Opportunity Register.

1655 **8.2.2 Determining if Energy Performance Improvement Actions were Identified and Planned**
 1656 **Outside of a SEM Program Cycle.**

1657 Pursuant to CPUC Decision 16-08-019, existing baseline conditions should be the basis for
 1658 measurement of SEM savings for behavioral, retro-commissioning, and operational projects as
 1659 well as capital projects. As such, EPIAs that were identified and planned for implementation
 1660 outside of any SEM Program Cycle would be considered part of the existing baseline condition
 1661 and resulting energy savings if the EPIA was implemented during any SEM Program Cycle shall
 1662 not be reported as part of the SEM program.

1663 The implementer shall work with the customer to identify and list, as part of the Opportunity
 1664 Register, EPIAs that were identified and planned outside of any SEM Program Cycle but not yet
 1665 implemented. The timely collection of information and documentation regarding these EPIAs is
 1666 critical, as time moves forward confidence in the information that new customer staff and
 1667 memories about these EPIAs will become less reliable. Documentation collected as part of the
 1668 ongoing SEM engagement is more trustworthy than that collected after the program
 1669 engagement.

1670 For each listed EPIA that was identified outside any SEM Program Cycle, a determination shall
 1671 be made if it was not only identified but also planned for implementation outside any SEM
 1672 Program Cycle. Energy savings resulting from EPIAs that are both identified and planned
 1673 outside of any SEM Program Cycle shall be included as part of the Non-SEM Program Energy
 1674 Savings. Energy savings that ultimately result from EPIAs that were identified outside of any
 1675 SEM Program Cycle but not planned for implementation shall be included as part of future SEM
 1676 Program Energy Savings when the EPIA is implemented during a Reporting Period.

1677 The determination whether an EPIA was not only identified but also planned for implementation
 1678 outside of any SEM Program Cycle shall be based on evidence of planning taking place within
 1679 the 12 months prior to the SEM Program Cycle. Evidence older than 12 months indicates that
 1680 while planning may have been started, EPIA implementation was stalled and the SEM program
 1681 influenced its implementation. A, “wish-list,” or brainstorming list of EPIA ideas does not qualify
 1682 as a planned EPIAs. Evidence of an EPIA being planned for implementation could include the
 1683 following:

1684 • Budget allocated for the EPIA.
 1685 • Contracts signed related to EPIA implementation.
 1686 • Purchase orders issued or other indications of spending on the EPIA.
 1687 • Internal project manager assigned.
 1688 • Detailed EPIA implementation scope and schedule developed.

1689 EPIAs shall not be considered as identified and planned outside of an SEM Program Cycle

1690 If an EPIA was identified and planned outside of an SEM Program Cycle but the implementation
 1691 was abandoned or postponed, the EPIA may be considered as “planned” during an SEM
 1692 Program Cycle if it can be demonstrated that the EPIA implementation was accelerated (e.g.,
 1693 from scheduled for implementation in three years to scheduled for implementation in one year).

1694 The Opportunity Register shall be updated to indicate if each listed EPIA is determined to have
 1695 been both identified and planned outside of any SEM Program Cycle or not. The rationale for
 1696 the determination shall be recorded as part of the Opportunity Register.

1697 Identification of EPIAs for which energy savings were removed from each type of energy
 1698 savings shall be documented.

1699 **8.3 Customer Learning and Leading**

1700 **SEM Program Cycle 1:** The implementer should lead, with customer engagement, the
 1701 collection of energy and relevant variable data. The calculation of EPIA energy savings should
 1702 be led by the implementer and shown to the customer to inform them of what appropriate levels
 1703 of calculation looks like.

1704 **SEM Program Cycle 2:** The customer should track energy performance on a regular basis with
 1705 implementer support and consultation. This should include tracking energy and relevant variable
 1706 data as well as ensuring energy savings for implemented EPIAs on the Opportunity Register are
 1707 calculated. The implementer may need to lead development of calculations of EPIA energy
 1708 savings but should do so with customer engagement. The implementer should ensure energy
 1709 performance is being tracked.

1710 **SEM Program Cycle 3:** The customer should collect energy consumption and relevant variable
 1711 data per the Energy Data Collection Plan and track energy performance using the Energy
 1712 Performance Tracking Tool. The implementer should ensure data are being collected. The
 1713 customer should lead calculation of energy savings from EPIAs with implementer support.

1714
 1715

9 Calculating Site-wide Energy Savings with Energy Consumption Adjustment Models

9.1 Process

Energy savings of all types of energy shall be calculated and confidence established for the Reporting Period. In order to calculate Site-wide Energy Savings during a Reporting Period the following process shall be followed:

1. Confirm the Reporting Period.
2. Calculate Avoided Energy Consumption energy savings.
3. Calculated incremental savings when energy consumption adjustment models are used for multiple Reporting Periods.
4. Annualize energy savings (if approved by PA).
5. Establish confidence in energy savings values.

Preparation of energy savings for regulatory reporting will be addressed in Section 10.

9.2 Confirm the Reporting Period

If not already done, a Reporting Period shall be established with a clear start and end date in accordance with Section 2.1.2.

9.3 Calculating Avoided Energy Consumption Energy Savings

9.3.1 Calculating Interval Avoided Energy Consumption Energy Savings

For each energy consumption adjustment model selected for use, Avoided Energy Consumption energy savings shall be calculated by applying the following equation using observed (actual) and estimated (predicted) energy consumption values for each interval of the Reporting Period.

$$\begin{aligned} \text{Energy Savings}_{\text{Reporting Period Interval}} &= \text{Energy Consumption}_{\text{Reporting Period Interval}}^{\text{Modeled}} \\ &\quad - \text{Energy Consumption}_{\text{Reporting Period Interval}}^{\text{Observed}} \end{aligned}$$

9.3.2 Aggregating Interval Avoided Energy Consumption Energy Savings

Avoided Energy Consumption energy savings for the entire Reporting Period are calculated by aggregating the Avoided Energy Consumption energy savings for each interval of the Reporting Period.

$$\text{Energy Savings}_{\text{Reporting Period}} = \sum_{i=1}^n \text{Energy Savings}_{\text{Reporting Period Interval } i}$$

Where

n = number of intervals in the Reporting Period

Energy savings calculated using the above equation are for the current Reporting Period as compared to the energy baseline and will be cumulative of all energy savings activities between

the end of the Baseline Period and the current Reporting Period. See Section 9.4 to determine incremental energy savings for the current Reporting Period.

Regardless of requests to annualize energy savings Avoided Energy Consumption Energy Savings shall be documented for all Reporting Periods.

9.3.3 Visualizing Energy Savings

The cumulative sum of differences (CUSUM) calculation is an effective means of quantifying and visualizing energy savings for each type of energy during the Reporting Period.

A CUSUM graph provides an illustration of the total savings achieved as compared to the energy baseline. A CUSUM graph for each type of energy for which energy consumption adjustment models are being used to calculate energy savings shall be developed and accompanied by a time-series plot of actual and predicted energy consumption.

NOTE: A consensus whether to display CUSUM energy savings as a positive or negative value does not exist. Some PA sponsored SEM programs mandate increasing energy savings be displayed as a positive value while other programs mandate the opposite. Implementers and customers can display CUSUM energy savings as positive or negative so long as graphical representations of CUSUM energy savings clearly indicate the direction of increased energy savings. At its discretion the sponsoring PA may require one approach or the other.

The implementation date of selected EPIAs listed on the Opportunity Register for which energy savings have been calculated shall be indicated on the CUSUM graph.

Significant changes in CUSUM slope, positive and negative, should be investigated with analysis results noted as footnotes to the CUSUM graph.

9.4 Establishing Confidence in Energy Savings

Fractional savings uncertainty (FSU) analysis is a method for judging the validity of energy savings based on regression modeling. An FSU calculation shall be conducted for each Site-wide Energy Savings value calculated and used as the basis of an energy savings value to be reported.

The fractional uncertainty can be estimated with the general FSU equation as follows:

$$\frac{\Delta E_{save,m}}{E_{save,m}} = t \cdot \frac{1.26 \cdot CV \left(\left(\frac{n}{n'} \right) \left(1 + \frac{2}{n'} \right) \cdot \frac{1}{m} \right)^{\frac{1}{2}}}{F}$$

Where:

- t= t-statistic for desired confidence level
- CV= coefficient of variation
- n= number of observations in the Baseline Period
- m = number of observations in the Reporting Period
- F= observed savings during Reporting Period
- n'= number of independent Baseline Period observations
- ρ= auto-correlation coefficient

$$n' = n \frac{(1 - \rho)}{(1 + \rho)}$$

According to ASHRAE Guideline 14:2014, for monthly data an assumption that autocorrelation is 0 so n' is equal to n .

When Reporting Period intervals are monthly or daily the improved FSU equation from Sun and Baltazar should be used which replaces the 1.26 coefficient in the above equation with a polynomial:

$$\frac{\Delta E_{save,m}}{E_{save,m}} = t \cdot \frac{(aM^2 + bM + c) \cdot CV\left(\left(\frac{n}{n'}\right)\left(1 + \frac{2}{n'}\right) \cdot \frac{1}{m}\right)^{\frac{1}{2}}}{F}$$

Where:

- M = number of months of Reporting Period data
- a , b , and c are defined as follows:

Data Interval	Monthly	Daily
a	-0.00022	-0.00024
b	0.03306	0.03535
c	0.94054	1.00286

Table 5: FSU Equation Coefficients.

ASHRAE Guideline 14-2002, Section 5.3.2.2 specifies that the level of uncertainty must be less than 50% of the annual reported savings, at a confidence level of 68%.

For an FSU value calculated with an energy consumption adjustment model spanning nine or more months:

- Less than 50%, the reported energy savings value should be considered valid.
- Greater than or equal to 50%, Implemented EPIAs on the Opportunity Register should be used to justify the energy savings calculated using the energy consumption adjustment model.
- Much greater than 50%, seen as an indicator that the energy savings are not valid.

Note that FSU can be artificially inflated due to the limited number of data points in each model. The above thresholds are not absolute requirements but are guidance. The overall validity of the model and FSU should be considered together when evaluating the acceptability of energy consumption adjustment model-based energy savings values. The table in Annex G – Fractional Savings Uncertainty Scenarios, provides additional information for different uncertainty scenarios.

9.5 Calculating Incremental Energy Savings for Consecutive Reporting Periods using the Same Energy Consumption Adjustment Model

Energy consumption adjustment models with a consistent Baseline Period can be used to calculate energy savings for multiple Reporting Periods. Energy savings values for consecutive Reporting Periods are by nature cumulative of energy savings resulting from actions taken in the current as well as prior Reporting Periods.

Incremental energy savings for the current Reporting Period shall be calculated if energy consumption adjustment models are used for more than one Reporting Period as a way of “artificially re-baselining” the energy consumption model.

Incremental Site-wide Avoided Energy Consumption energy savings for the current Reporting Period shall be calculated by subtracting the PA approved incremental energy savings from prior Reporting Periods from the energy savings of the current Reporting Period. The prior Reporting Period energy savings must be cumulative with all other prior Reporting Periods for which the same energy consumption adjustment model and associated energy baseline have been used. **Error! Reference source not found.** provides an example of how incremental Site-wide Avoided Energy Consumption are determined when an energy consumption adjustment model is used for multiple years.

If an energy consumption adjustment model is re-baselined (a new energy baseline established and new energy consumption adjustment model(s) developed) any savings achieved prior to the new Baseline Period do not need to be removed from energy savings calculations made for the current Reporting Period as they will have been incorporated into the new model. Energy savings achieved during the Baseline Period must be accounted for following the guidance in Section 7.6.

9.6 Annualization of Energy Savings

Annualization of Site-wide Energy Savings shall only be performed when annualization will demonstrably improve the meaning and accuracy of energy savings and with PA approval. See Section 1.4 for additional discussion on annualization.

If, in this case, a top down approach will be attempted in the subsequent Reporting Period, a new Baseline Period that encompasses the current Reporting Period shall be established along with new energy consumption adjustment model(s). Appropriate adjustments to the new Baseline Period shall be made to account for any known EPIAs implemented during that time.

If annualization of energy savings is authorized by the PA, the following process should be followed:

9.6.1 Considerations for Seasonality

When the distribution of relevant variables used for a particular energy consumption adjustment model is expected to be markedly different throughout the Reporting Period, this distribution must be considered when annualizing energy savings. If the ratio of higher to lower expected production level is not anticipated to stay seasonally consistent, the Reporting Period can be divided into two or more distinct periods for a given energy consumption adjustment model. This method is generally only feasible for daily models. There must be a minimum number of intervals (normally 30 for daily models) in each period to justify the split. Use of this method shall be documented.

9.6.2 Annualization Period

Annualization of energy savings is dependent upon extrapolating energy savings calculated during a short time period (Annualization Period) established towards the end of the Reporting Period. This time period, the Annualization Period, shall be at least 90 and no more than 120 consecutive days within the final 9 months of the Reporting Period.

If an energy consumption model has been developed for a time period shorter than 90 days annualization shall not be performed and Avoided Energy Consumption values should be used.

Annualization Periods longer than 120 days can be utilized depending on the variability of the site but shall be wholly within the final 9 months of the Reporting Period. If the customer's operation is highly seasonal, and only has one model, a longer Annualization Period that addresses seasonal impact on varying energy savings rates should be selected. The rationale for selecting an Annualization Period duration longer than 120 days shall be documented.

Ideally, the end of the Annualization Period should be established as close to the end of the Reporting Period as possible to reflect the full impact of the activities taken during the Reporting

1879 Period. The rationale for ending the Annualization Period prior to the end of the Reporting
1880 Period shall be documented.

1881 9.6.3 Confirming Data Quality within the Annualization Period

1882 Data collected during the Annualization Period should be reviewed in detail to detect anomalous
1883 values and account for situations that did not happen in the Baseline Period.

1884 Individual data intervals in the Annualization Period should be flagged if a relevant variable data
1885 point is $\pm 10\%$ beyond the bounds of the energy baseline data set. These points may be
1886 handled in one of three ways:

- 1887 • Include the point without alteration.
 - 1888 ○ This is appropriate if the residual for the point is not an outlier compared to the
 - 1889 representative population of residuals (as determined by the implementer).
- 1890 • Exclude the point.
 - 1891 ○ This is appropriate if the residual of the outlier point is an outlier compared to the
 - 1892 overall population of residuals. In this case the energy savings from this outlier
 - 1893 point would have an outsized effect on the energy savings measurement.
- 1894 • Shift the Annualization Period.
 - 1895 ○ This is appropriate if the interval in question is towards the end of the current
 - 1896 Annualization Period and shifting the period will omit the interval in question while
 - 1897 otherwise maintaining the integrity of the Annualization Period.
- 1898 • Remodel
 - 1899 ○ This is appropriate if no Annualization Period can be established during which a
 - 1900 valid energy savings value can be calculated.

1901 If an outlier is detected, qualitative justification based on visual representation of the data and
1902 quantitative justification should be provided, rationalizing the selected approach used to address
1903 the outlier. The selected approach should be documented.

1904 9.6.4 Calculating annualized energy savings

1905 Annualized energy savings shall be calculated using the following equation:

1906
$$\text{Annualized Energy Savings} = \left(\sum_{i=1}^n (\text{Energy Savings})_i \right) \times \left(\frac{n_{\text{year}}}{n} \right)$$

1907 Where

1908 n = number of intervals in the Annualization Period

1909 n_{year} = 365 days represented in the intervals being used

1910 With energy savings being calculated using the equation in Section 9.3.1.

1911 9.7 Customer Learning and Leading

1912 SEM Program Cycle 1: The implementer should lead the calculation to determine Site-wide
1913 Energy Savings and show the customer how that process was conducted.

1914 SEM Program Cycle 2: The customer should work with the implementer to calculate Site-wide
1915 Energy Savings.

1916 SEM Program Cycle 3: The customer should lead the calculation of Site-wide Energy Savings
1917 with implementer support.

1918

1919 10 Preparing Energy Savings for Regulatory Reporting

1920 10.1 General

1921 For the current Reporting Period, Avoided Energy Consumption energy savings values shall be
1922 calculated for each type of energy included in the M&V process using one of two methods:

- 1923 1. Energy consumption adjustment models, if the development of valid energy consumption
1924 models is successful.
- 1925 2. Aggregation of energy savings from individual EPIAs listed on the Opportunity Register.

1926 Annualized energy savings shall only be reported with PA permission per the requirements of
1927 this M&V Guide.

1928 For each type of energy included in the M&V process, if one or more valid energy consumption
1929 adjustment models were developed and used to calculate energy savings then energy savings
1930 for that type of energy shall be reported using the top-down method.

1931 For each type of energy, if valid energy consumption adjustment models were not developed
1932 and used to calculate energy savings then the bottom-up method of aggregating energy savings
1933 resulting from the implementation of EPIAs listed on the Opportunity Register shall be reported
1934 for that type of energy.

1935 If for a given type of energy one or more energy consumption adjustment models were
1936 developed for part of the Reporting Period (e.g. during seasonal operations for a resort or food
1937 producer) but one or more energy consumption adjustment models could not be developed for
1938 the other part of the Reporting Period energy savings may be reported both with a top-down and
1939 bottom-up method for the respective periods.

1940 Energy savings for different types of energy may be reported using different methods for the
1941 same customer (e.g. natural gas energy savings reported using a bottom-up approach and
1942 electricity energy savings reported using a top-down approach).

1943 As described in more detail in Section 1.4: For each type of energy included in the M&V
1944 process, annualization of top-down based energy savings may be performed only in the case
1945 when an energy consumption adjustment model is being retired or a customer will not be
1946 participating in the SEM program after the current Reporting Period. Bottom-up estimates will be
1947 prorated based on the installation date.

1948 When communicating with the customer, PA, and CPUC case shall be taken to label energy
1949 savings as either “avoided energy consumption energy savings” or “annualized energy savings.”
1950 The label “energy savings” may be used with the implicit assumption it refers to energy savings
1951 determined on an Avoided Energy Consumption basis.

1952 The SEM Reporting Period Performance Report, Opportunity Register, and Energy Data and
1953 Performance Tracking Tool shall be provided to the CPUC as requested when reporting energy
1954 savings. The CPUC may have additional requests for data though the SEM Reporting Period
1955 Performance Report should be adequate to evaluate if the energy savings reported conform to
1956 the requirements of this M&V Guide.

1957 Program cost-effectiveness shall be based upon SEM Program Energy Savings.

1958 This M&V Guide does not consider regulatory reporting aimed to evaluate the development of
1959 customer EnMS. As the M&V process is a component of a functional EnMS, requests pertaining
1960 to the customer’s understanding, activities, and leadership of parts of the M&V process may be
1961 made by the CPUC.

10.2 Energy Savings Terminology

The below listing defines types of energy savings that will be referenced in the process of appropriately removing different types of energy savings from Site-wide Energy Savings for each type of energy.

1. **Site-wide Energy Savings:** Incremental, energy savings for a given type of energy resulting from the aggregation of energy savings from each energy consumption adjustment model developed for the same energy type. These “modeled” savings encompass all energy saving types listed below.
2. **Non-SEM Program Energy Savings:** Energy savings calculated for EPIAs identified and planned outside of any SEM Program Cycle and implemented during the current Reporting Period, whether receiving other incentives or not.
3. **SEM Program Energy Savings:** Site-wide Energy Savings minus Non-SEM Program Energy Savings. This value is the combination of BRO, capital, and deemed projects that were influenced by SEM. This energy savings value is used to calculate program cost-effectiveness.
4. **SEM Non-incented Project Energy Savings:** Energy savings for an EPIA (project) identified during any SEM Program Cycle and implemented during the current Reporting Period that is to receive an incentive from a PA program other than the SEM program. PA custom capital M&V requirements (ex-ante, ex-post, etc.) may apply.
5. **SEM Incented Energy Savings:** SEM Program Energy Savings minus SEM Non-incented Project Energy Savings. At the discretion of the PA, this energy savings value can be used to pay SEM performance incentives.

Mathematically:

$$\text{SEM Program Energy Savings} = \text{Site-wide Energy Savings} - \text{Non-SEM Program Energy Savings}$$

$$\text{SEM Incented Energy Savings} = \text{SEM Program Energy Savings} - \text{SEM Non-incented Project Energy Savings}$$

The figure below illustrates the relationship of the different types of energy savings.

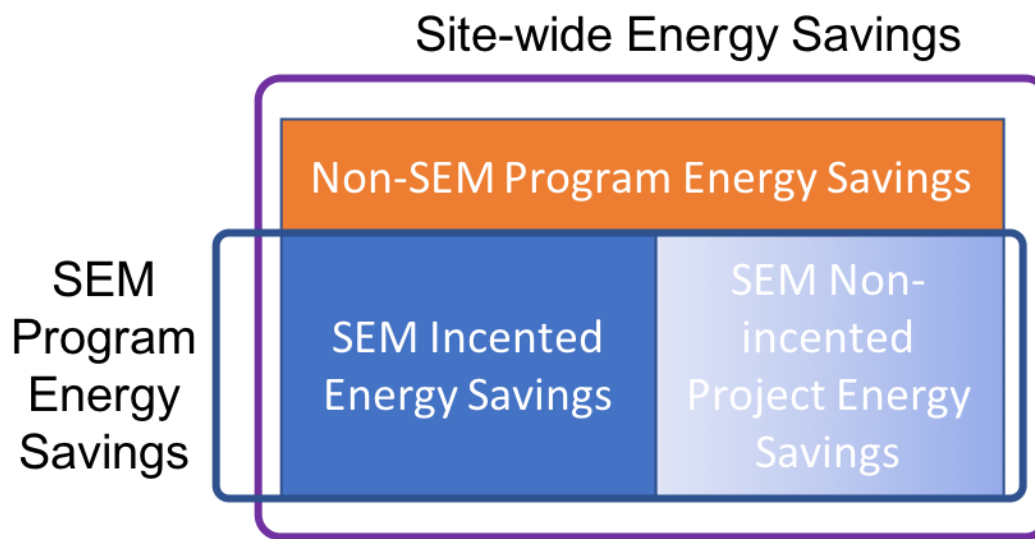


Figure 6. Relationship Between Different Types of Energy Savings.

10.3 Requirements for Claiming Savings via Top Down Method

If one or more valid energy consumption adjustment models were created and used to calculate energy savings for a given type of energy, then incremental Avoided Energy Consumption energy savings for the current Reporting Period shall be used as the basis of Site-wide Energy Savings.

If the PA has provided explicit permission to report annualized energy savings values, then all other energy savings types shall also be used and reported on an annualized basis (including those related to individual EPIAs).

Incremental energy savings shall be reported rather than energy savings cumulative of multiple Reporting Periods.

If incremental energy savings for a given type of energy are calculated for the purposes of regulatory reporting, energy savings resulting from EPIAs implemented during the Reporting Period that are incentivized by another PA program or were identified and planned outside of participation in any SEM Program Cycle shall be removed from the energy savings value reported.

The process used to remove energy savings resulting from EPIAs implemented during the Reporting Period that are incentivized by another PA program or were identified and planned outside of participation in any SEM Program Cycle shall be documented. See Section 8.2.2 how to determine if an EPIA would be included or excluded.

Site-wide Projected Energy Savings, Non-SEM Program Energy Savings, SEM Program Energy Savings, SEM Non-incented Project Energy Savings, and SEM Incented Energy Savings shall be calculated for each type of energy.

10.4 Requirements for Claiming Energy Savings via Bottom Up Method

If approved by the PA, then a bottom-up approach of calculating energy savings for a given type of energy may be used for the Reporting Period. This bottom-up approach is only allowed if one or more energy consumption adjustment models per the requirements of this M&V Guide cannot be developed, used to calculate energy savings, and used to report energy savings to the PA for a given type of energy.

10.4.1 Determining if Avoided Energy Consumption or Annualized Energy Savings Should be Reported

Only energy savings for EPIAs listed on the Opportunity Register, and assessed to not have been identified and planned outside of a PA sponsored SEM program shall be included in the bottom-up calculation. Not all EPIAs for which energy savings have been calculated must be included in the bottom-up calculation. Reasons to not include energy savings from specific EPIA may include lack of confidence in the estimated energy savings value and uncertainty that the implemented EPIA will remain in place during the SEM Program Cycle.

If the PA has not given explicit permission to report annualized savings, then energy savings shall be reported on an Avoided Energy Consumption basis. Only the prorated portion of the annualized EPIA energy savings for the current Reporting Period shall be reported to the PA. The balance of the annualized energy savings for the EPIA shall be claimed in the subsequent Reporting Period. If the customer does participate in the SEM program in the subsequent year, the balance of the annualized energy savings for the EPIA may still be claimed in the subsequent year with no associated cost of program implementation.

If the PA has given explicit permission to report annualized energy savings, then energy savings shall be reported on an annualized basis.

10.4.2 Aggregating EPIA Energy Savings

Reporting Period energy savings can be calculated from the aggregation of energy savings resulting from the implementation of individual EPIAs, a “bottom-up approach.”

If a bottom-up calculation is made in addition to development and use of a valid energy consumption adjustment model for the same type of energy, the resulting aggregated energy savings can be used as a “gut check” in comparison to energy savings calculated with energy consumption adjustment models.

As part of a PA sponsored SEM program, energy savings calculated from the two energy savings determination methods (top-down and bottom-up) shall not be reconciled as the foundational assumptions of the two methods are incongruent.

If the bottom-up aggregation of energy savings approach to calculating energy savings is used to report energy savings, it should be done so with the understanding that evaluation of energy savings for individual EPIA listed on the Opportunity Register may occur. Energy savings for each EPIA include in the submitted energy savings report to the CPUC shall be developed using the guidance of Annex D – Bottom Up EPIA Calculation Effort. Evaluation of bottom-up savings shall not be conducted to the level of rigor and specificity as is conducted for projects that are part of custom capital incentive programs. The evaluation shall be a check of the reasonable nature of the EPIA energy savings calculation approach, recognizing the requirements of this M&V Guide direct that a detailed M&V plan for each EPIA is not to be developed.

10.5 Considerations for Non-utility Energy (aka Non-IOU Fuels)

The implementer shall be responsible for ensuring the customer pays a public purpose program surcharge for each type of energy for which energy savings will be reported and that the reported energy savings value is attributed to energy for which the public purpose program surcharge was paid.

Energy savings shall only be reported when they are coincident with time intervals when the customer is purchasing power from the grid.

The implementer shall be responsible for adjusting energy savings values to account for PA and CPUC requirements pertaining to claiming energy savings for sites that have on-site energy generation and non-utility (non-IOU) supplied energy/fuel (both referred to as non-utility energy in this M&V Guide). In general, energy savings claims should only support impacts to PA supplied energy. If a site generates energy and exports excess energy to the grid, those time periods shall be excluded from savings claims for that type of energy.

In general, the CPUC November 6, 2015 published, “Energy Efficiency Savings Eligibility at Sites with non-IOU Supplied Energy Sources – Guidance Document” version 1.1 should be consulted when considering if non-utility energy will affect reportable energy savings.

10.5.1 Top-Down Method

For each interval of the energy consumption adjustment model (e.g. if the model is developed on a monthly basis the evaluation of non-utility energy shall be conducted on a monthly basis) determine:

1. “Predicted Energy Consumption” = Energy consumption adjustment model predicted energy consumption (grid purchased and on-site generated energy consumption without any Reporting Period EPIAs or other energy savings actions implemented).
2. “Actual Energy Consumption” = Actual energy consumption (grid purchased and on-site generated energy consumption with any Reporting Period EPIAs or other energy savings actions implemented).

- 2086 3. "Predicted Energy Consumption Less On-site Generation" = On-site generated energy
2087 consumed within the M&V boundaries removed from "Predicted Energy Consumption"
2088 ("Predicted Energy Consumption Less On-site Generation" does not include energy
2089 generated on-site and exported from the site).
2090 4. "Site-wide Energy Savings" = "Predicted Energy Consumption" - "Actual Energy
2091 Consumption."

2092 For each interval of the energy consumption adjustment model, use the below logic to
2093 determine if reportable energy savings need to be adjusted to account for non-utility energy.
2094 Each logic set (i.e. a, b, and c) below is provided in a full statement using the terminology from
2095 above as well as in mathematical form using the numbered items (i.e. 1, 2, 3, and 4) from
2096 above.

- 2097 a) If "Site-wide Energy Savings" are less than the "Predicted Energy Consumption Less
2098 On-site Generation" and "Site-wide Energy Savings" are greater than 0, then Site-wide
2099 Energy Savings for that interval do not need to be adjusted for non-utility energy and
2100 "Site-wide Energy Savings" are the originally calculated "Site-wide Energy Savings."

2101 If $4 < 3$ and $4 > 0$ then 4 is the interval energy savings not adjusted for non-utility energy

- 2102 b) If "Site-wide Energy Savings" are greater than the "Predicted Energy Consumption Less
2103 On-site Generation" and "Site-wide Energy Savings" are greater than 0, then Site-wide
2104 Energy Savings for that interval need to be adjusted for non-utility energy and "Site-wide
2105 Energy Savings" shall be the "Predicted Energy Consumption Less On-site Generation"
2106 value.

2107 If $4 > 3$ and $4 > 0$ then 3 is the interval energy savings adjusted for non-utility energy

- 2108 c) If neither of the above are true then "Site-wide Energy Savings" shall not be adjusted for
2109 non-utility energy and "Site-wide Energy Savings" are the originally calculated "Site-wide
2110 Energy Savings."

2111 If a and b are not true then 4 is the interval energy savings not adjusted for non-utility energy

2112 Note that energy exports shall be ignored such that grid purchased energy is not reduced by
2113 exported energy.

- 2114 • Generally, natural gas is not exported to the grid.
2115 • This applies when converting electricity export from a generator that uses natural gas or
2116 bio-fuel to generate electricity.

2117 Graphical representation of when energy savings would be reduced due to non-utility energy is
2118 illustrated below in Figure 7.

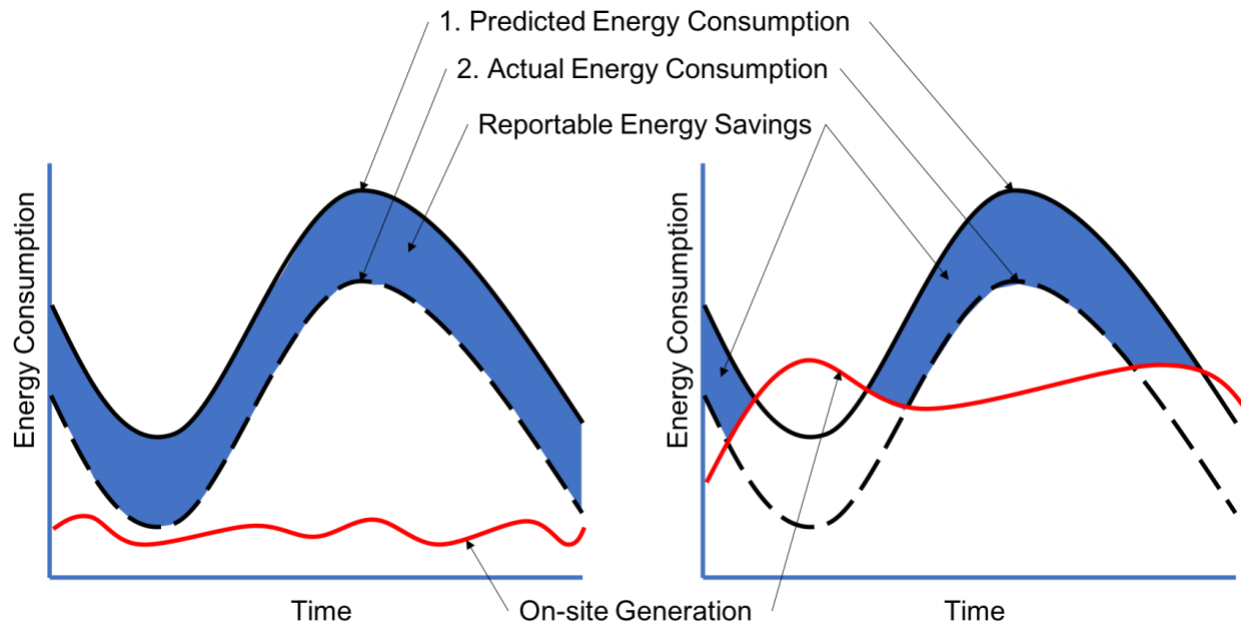


Figure 7: Illustration of when energy savings are reduced by non-utility energy

10.5.2 Bottom-Up Method

When energy savings are being determined with a bottom-up approach, the guidance of the CPUC November 6, 2015 published, “Energy Efficiency Savings Eligibility at Sites with non-IOU Supplied Energy Sources – Guidance Document” version 1.1 shall be followed to determine the affect and accounting of non-utility energy. The PA shall confirm appropriate application of the CPUC guidance.

10.6 Negative Energy Savings

Energy consumption adjustment models may indicate that worsening energy performance (sometimes referred to as backsliding) occurred as compared to the energy baseline or relative to prior Reporting Periods when energy consumption models are used for multiple concurrent Reporting Periods.

Negative energy savings could be a result of non-program-related issues beyond the control of customer, such as market conditions, societal/environmental events, or a change in facility operations. In these instances, however, the efficacy of the implemented EPIA should be verified.

Regardless of if and when backsliding occurs, energy savings shall still be calculated per the requirements of this M&V Guide. This may result in negative energy savings. Negative energy savings shall be investigated. Efforts taken to understand the cause and size of negative savings shall be documented if they are calculated.

Negative energy savings shall be reported in the same way as positive energy savings values if reasonable explanation of the negative savings value can be provided. In some cases no reasonable explanation of the negative savings value can be provided. In these instances, Site-wide Energy Savings shall be reported as 0 or a bottom-up approach should be used. The PA shall have final approval over reporting 0 savings rather than the negative value.

2145 **10.7 Customer Learning and Leading**

2146 Preparation for regulatory reporting should be conducted by the implementer. The implementer
2147 may want to explain the final reported values to the customer as this value may be related to a
2148 performance incentive payment.

11 Calculating Demand Savings

Electricity demand savings can be difficult to determine and can be done in multiple ways.

In 2021, the CPUC evaluator created an Excel based tool that uses an input of claimed electricity savings and existing load shapes to determine demand savings. This CPUC-developed demand savings tool shall be the default approach to determining reportable electricity demand savings. The CPUC-developed tool may be updated by the CPUC at its discretion.

Alternative methods to determining electricity demand savings shall only be used if approved by the PA.

Alternative methods of determining electricity demand savings using energy savings determined from energy consumption adjustment models shall only be conducted when the model is based on hourly or more frequent interval data to calculate demand savings. This hourly or more frequent interval data requirement may not align with the interval frequency with which energy consumption adjustment models were developed.

The shift towards Total System Benefits will affect how demand savings are valued and potentially determined. **Error! Reference source not found.** offers a brief introduction to the concept.

11.1 Customer Learning and Leading

SEM Program Cycle 1: The implementer should calculate demand savings and show the customer how that process was conducted.

SEM Program Cycle 2: The implementer should calculate demand savings with engagement from the customer.

SEM Program Cycle 3: The implementer should work with the customer to calculate demand savings.

12 Greenhouse Gas Savings

Greenhouse Gas (GHG) emissions are regulated by the California Air Resources Board (CARB). Many companies have voluntarily joined decarbonization programs with GHG emission reduction targets and reporting requirements. A wide variety of methods exist for establishing a GHG inventory and for reporting GHG emissions reductions. Reporting GHG emissions reductions is currently not a regulatory requirement of this M&V Guide though changes to CPUC policies are being made to better align with GHG related objectives established by the California legislature and governor. The shift towards Total System Benefits will affect how GHG emission savings are valued and potentially determined. Annex I – Total System Benefits offers a brief introduction to the TSB concept.

The calculation of GHG emissions itself is not a requirement of this M&V Guide but guidance is provided here as the likelihood of interest in GHG emissions by the PA and customer is growing. If GHG emissions are calculated as part of the PA sponsored SEM program the requirements (shall statements) of this section shall be followed.

12.1 Sources of GHG Emissions

In the US, nearly 80% of all GHG emissions are energy related.⁵ For organizations, these energy-related GHG emissions can come from:

- Direct GHG emissions from the combustion of energy (e.g. natural gas used in process heating) at the site.
- Indirect GHG emissions that come from consumption of delivered energy (e.g. electricity consumed) at the site.
- Indirect GHG emissions that come from energy consumed by activities (e.g. outsourced production processes) throughout an organization's value chain.

Additionally, other gaseous species such as those from refrigeration system and process emissions contribute to climate change. These non-energy related GHG emissions can be managed with an energy management system but are not the focus of this M&V Guide. This M&V Guide can be used to inform the determination of energy-related GHG emission reductions.

The process of energy accounting (collection of energy consumption data by energy type) and energy savings determined via top down or bottom-up methods can aid in the determination of energy-related GHG emissions reductions.

The purpose for determining energy-related GHG emissions reduction should be established. This purpose will inform the scope and method by which energy-related GHG emissions should be determined.

12.2 GHG Emission Scopes

The GHG Protocol's, "Corporate Accounting and Reporting Standard," defines three categories, or "scopes" of direct and indirect emissions that are widely used and should be considered:⁶

- **Scope 1 Emissions: Direct GHG emissions.**
Direct GHG emissions occur from sources that are owned or controlled by the organization, for example, emissions from combustion in owned or controlled boilers,

⁵ Intergovernmental Panel on Climate Change (IPCC), Climate Change 2022 Impacts, Adaptation, and Vulnerability Summary for Policymakers, Accessed May 2022,

https://www.ipcc.ch/report/ar6/wg2/downloads/report/IPCC_AR6_WGII_FinalDraft_FullReport.pdf

⁶ World Business Council for Sustainable Development and World Resources Institute, The Greenhouse Gas Protocol – A Corporate Accounting and Reporting Standard, March 2004

2213 furnaces, vehicles, etc.; emissions from chemical production in owned or controlled
2214 process equipment.

2215 • **Scope 2 Emissions: Electricity indirect GHG emissions.**

2216 Scope 2 accounts for GHG emissions from the generation of purchased electricity,
2217 steam, heat, or cooling consumed by the organization. Purchased electricity is defined
2218 as electricity that is purchased or otherwise brought into the organizational boundary of
2219 the company. For purchased energy, scope 2 emissions physically occur at the site
2220 where electricity, steam, heat, or cooling is generated.

2221 • **Scope 3 Emissions: Other indirect GHG emissions.**

2222 Scope 3 is an optional reporting category that allows for the treatment of all other indirect
2223 emissions. Scope 3 emissions are a consequence of the activities of the organization,
2224 but occur from sources not owned or controlled by the organization. Some examples of
2225 scope 3 activities are extraction and production of purchased materials; transportation of
2226 purchased fuels; and use of sold products and services.

2227 For most organizations, inclusion of scope 1 and scope 2 emissions is the minimum that should
2228 be considered when determining the EnMS scope and boundaries. Data collected by following
2229 the processes of this M&V Guide may be of use in determining scope 3 emissions, but this M&V
2230 Guide focuses on guidance related to scope 1 and 2 emissions.

2231 **12.3 Care When Selecting Methods to Determine Energy-related GHG Emissions**
2232 **Reductions**

2233 This M&V Guide was not designed to determine a greenhouse gas (GHG) emission inventory or
2234 GHG emission reductions. This M&V Guide reports normalized energy savings which can be
2235 used with GHG emission factors for specific energy types to establish a *normalized energy-*
2236 *related GHG emissions reduction* value, an indicator of GHG performance improvement.

2237 Use of normalized energy savings to determine GHG emissions reduction values is not
2238 conformant with most GHG reporting methods and does not convey actual GHG emissions
2239 reductions. Major GHG inventory and reporting protocols, such as the World Resources
2240 Institute's and World Business Council for Sustainable Development's GHG Reporting
2241 Protocol⁷, provide guidance on how to establish a GHG emissions inventory for a given period
2242 of time. This inventory is not normalized for variables such as occupancy, production, or
2243 weather. The difference between GHG emission inventories for two different time periods can
2244 be used to establish if GHG emissions have been reduced on an absolute basis. It is worth
2245 noting these absolute basis methods of reporting GHG inventories and reductions are dominant
2246 in decarbonization programs and policies.

2247 A recent study of 86 industrial facilities was conducted by the Lawrence Berkeley National
2248 Laboratory to understand variation in calculated GHG emissions reduction using an SEM M&V
2249 type approach (the SEP M&V Protocol) compared to one of the most widely used GHG
2250 inventory reporting protocols from WRI, the GHG Reporting Protocol. The analysis showed
2251 significant deviations in estimates for GHG reductions, primarily because the SEP M&V method
2252 uses regression analysis to normalize relevant variables, while the WRI methods rely on
2253 absolute energy consumption. The variation of results between the two approaches ranged from
2254 negligible to more than 500%. This variance was largely driven by conditions when relevant
2255 variables used in the development of energy consumption adjustment models was high between
2256 the Baseline Period and Reporting Period. Lower variance in the relevant variables reduced the
2257 difference in reported GHG emissions. Suggestion to use energy consumption model based

⁷ WRI, Greenhouse Gas Protocol, <https://www.wri.org/initiatives/greenhouse-gas-protocol>

2258 GHG savings as a proxy for absolute emissions reduction when relevant variable variance is
2259 low is faulty. This approach inherently and needlessly introduces error when a viable alternative
2260 method exists and can make use of already collected energy data. Other major GHG emissions
2261 reduction protocols such as the Science Based Targets initiative do not allow for normalized
2262 GHG emissions reporting at this time.

2263 As GHG emissions reduction protocols such as the GHG Reporting Protocol and the regulatory
2264 reporting required by CARB does not allow for normalized GHG emissions reporting care should
2265 be taken to contextualize and properly label GHG emissions reductions determined using
2266 normalized energy savings values. Only GHG emissions reductions conforming to a major GHG
2267 emissions reduction protocol should be presented as “GHG emissions reductions” or with other
2268 similar labels.

2269 **12.4 Methods, Guides, and Protocols Commonly used to Establish GHG Inventories** 2270 **and Emissions Reductions**

2271 Users of the M&V Guide wishing to establish GHG inventories and emissions reductions should
2272 be familiar with methods, guides, and protocols used to establish GHG inventories and
2273 emissions reductions.

2274 As the legislatively authorized regulator of GHG emissions, CARB mandates reporting of GHG
2275 emissions and participation in California’s cap and trade program depending on a site’s GHG
2276 emissions. As reporting requirements and regulations may change, implementers should stay
2277 aware of current CARB policies. Currently CARB requires reporting of Scope 1 emissions only
2278 on an absolute basis.^{8,9}

2279 Implementers and customers alike should be aware of other relevant GHG inventory and
2280 emissions reduction program and policies. These include the WRI GHG Reporting Protocol,
2281 Science Based Targets initiative,¹⁰ and the U.S. Environmental Protection Agency’s Center for
2282 Corporate Climate Leadership.¹¹

2283 **12.5 SEM Program GHG Reduction Calculation Requirements**

2284 The implementer shall assess if the customer wishes to discuss GHG inventories, reporting,
2285 reduction calculations, or other related topics. This conversation may be part of the larger SEM
2286 program engagement.

2287 If the customer would like to discuss GHG related M&V the implementer shall document if the
2288 customer has an existing GHG emissions reduction target and if they are required or planning to
2289 use a specific GHG emissions reduction reporting mechanism.

2290 The implementer shall work with the customer to understand their current and future GHG
2291 related program engagements, both voluntary and required.

2292 The implementer shall discuss different methods of creating GHG inventories, reporting, and
2293 reduction calculations with the customer.

2294 If GHG emissions reductions are calculated as part of a PA sponsored SEM program the
2295 implementer shall calculate and clearly and consistently label energy-related GHG emissions

⁸ California Air Resources Board, Mandatory GHG Reporting – Guidance Documents, Accessed May 2022, <https://ww2.arb.ca.gov/mrr-guidance>

⁹ California Air Resources Board, Cal e-GGRT, Accessed May 2022, <https://ssl.arb.ca.gov/Cal-eGGRT/login.do>

¹⁰ Science Based Targets initiative (SBTi), Set a Target, Accessed May 2022, <https://sciencebasedtargets.org/set-a-target>

¹¹ United States Environmental Protection Agency, EPA Center for Corporate Climate Leadership, Accessed May 2022, <https://www.epa.gov/climateleadership>

2296 reductions as being “normalized emissions reductions,” or “absolute emissions reductions,” and
2297 include description of the method and scopes included in the reported value.

2298 **12.6 Customer Learning and Leading**

2299 The implementer and customer should discuss if calculating energy-related GHG emissions
2300 reductions is of interest. This guidance on customer learning and leading assumes the customer
2301 is interested in calculating energy-related GHG emissions reductions and that GHG emissions
2302 reductions are included as part of a PA sponsored SEM program.

2303 **SEM Program Cycle 1:** The implementer and customer should discuss and select appropriate
2304 energy-related GHG emission reduction methods. The Implementer should ensure the customer
2305 understands what the emissions reduction metric will mean and who it is useful to report to.

2306 The implementer should calculate energy-related GHG emissions reductions for the selected
2307 methods. The implementer should discuss the calculated values with the customer and clearly
2308 explain how to express the results (i.e. if they are normalized or not).

2309 **SEM Program Cycle 2:** The implementer should work with the customer to confirm the selected
2310 energy-related GHG emission reduction methods and calculate results.

2311 **SEM Program Cycle 3:** The customer should lead the calculation of energy-related GHG
2312 emissions with support from the implementer.

2313 13 Mid-Year Review of the M&V Process and Results

2314 13.1 General

2315 Materials used as part of the Mid-Year Review should be developed so they become
2316 components of the SEM Reporting Period Performance Report.

2317 A successful Mid-Year Review will enable the PA to confirm the following Mid-Year Review
2318 Focus Topics:

- 2319 1. **Site Characterization:** The customer site has been well characterized based upon the
2320 requirements of this M&V Guide.
- 2321 2. **M&V Process and Customer Engagement:** The M&V process outlined in this M&V
2322 Guide is being conducted with appropriate customer engagement and leadership.
- 2323 3. **Energy Data Collection Plan:** The Energy Data Collection Plan has been developed
2324 and updated to reflect current needs.
- 2325 4. **Energy Data and Performance Tracking Tool:** The Energy Data and Performance
2326 Tracking Tool is developed and used.
- 2327 5. **Bottom-up Approach:** A request to not pursue energy consumption adjustment
2328 modeling for a given type of energy, if such request is made.
- 2329 6. **Energy Consumption Adjustment Models:** The continued use of a newly developed
2330 or previously developed energy consumption adjustment model is appropriate.
- 2331 7. **Opportunity Register:** The Opportunity Register is being updated appropriately.
- 2332 8. **Energy Management Assessment:** The most recent energy management assessment
2333 has been conducted and reported.
- 2334 9. **Greenhouse Gases:** The customer has conveyed their interest regarding the reduction
2335 of greenhouse gases and is informed how the SEM M&V process can help their
2336 reporting needs.

2337 13.2 Process

2338 The Mid-Year Review shall occur approximately four to six months after the start of an SEM
2339 Program Cycle and then again approximately 12 months after. The implementer may request to
2340 delay the first Mid-Year Review with PA permission. Reasons to delay the first Mid-Year Review
2341 may include timing of SEM program delivery and challenges and data availability to develop
2342 energy consumption adjustment models.

2343 The Mid-Year Review Topics are addressed differently for first time Mid-Year Reviews
2344 compared to subsequent Mid-Year Reviews. First time Mid-Year Reviews require detailed
2345 documentation as the customer is new to the SEM program and the documentation has not
2346 been previously presented to the PA. Subsequent year Mid-Year Reviews focus on confirming
2347 that previously presented materials and documents are still accurate and any changes are
2348 presented.

2349 The Mid-Year Review can be conducted in person, remotely via web meeting, or through desk
2350 audit by PA staff. The PA shall specify how the Mid-Year Review will be conducted.

2351 The implementer shall provide the PA materials addressing each of the six Mid-Year Review
2352 Focus Topics. Details of materials to be provided are listed below. The PA shall review the Mid-
2353 Year Review materials and determine if the six Mid-Year Review Focus Topics are appropriately
2354 addressed.

2355 13.3 Mid-Year Review Focus Topics

2356 The following sections detail the components and materials that shall be provided by the
2357 implementer to the PA as part of the Mid-Year Review. The PA may require additional
2358 documentation.

13.4 First Time Mid-Year Review

The following items shall be provided as part of the Mid-Year Review:

- Documentation that meets the requirements of Section 14.1.2 thought Section 14.1.7 shall be provided.
- If a bottom-up approach is being sought, a Notification of Bottom-up Method of Determining Energy Savings shall be presented at this time to the PA for review and approval (see Section 7.2 for details).
- If available, EMA results shall be provided.
- Documentation that meets the requirements of Section 14.1.12, as fully as can be met at this time, shall be provided.

All required items listed above shall be presented is available. If the required documentation is not available justification from why it is not available shall e provided. Such justification may relate to customer participation, continued efforts to develop valid energy consumption adjustment models, etc. If valid energy consumption adjustment models have not yet been developed but are still being attempted the reason for the development challenges shall be documented and presented.

13.5 Subsequent Year Mid-Year Reviews

Subsequent year Mid-Year Reviews focus on understanding if and what changes have occurred since the previous SEM Reporting Period Performance Report that may affect the success of the SEM program. All of the questions below shall be answered. If the answer to any of the questions is “yes,” additional details shall be provided describing how the SEM program may be affected.

13.5.1 Site Characterization

- Have there been any significant changes to the customer operations and site?
- Are there any concerns with the customer that may affect program success?
- Have there been any changes to sources of non-utility energy?
- Are there any plans for changing if non-utility energy is procured or generated on-site?

13.5.2 M&V Process and Customer Engagement

- Will the customer be expected to participate more in the M&V process?

13.5.3 Energy Data Collection Plan

- Has the data collection plan changed from the prior year?
- Are there any new utility or non-utility meters from which data used in the energy consumption adjustment model will be taken?
- Have non-utility meters been maintained per manufacture guidance?
- Are there any delays in obtaining data?

13.5.4 Energy Data and Performance Tracking Tool

- Has the Energy Data and Performance Tracker Tool been updated to reflect change in the model and additional new data?
- Is the customer using the Energy Data and Performance Tracker Tool?

13.5.5 Bottom Up Approach

- Will a bottom-up approach be used for any energy types?

If a bottom-up approach is being sought, a Notification of Bottom-up Method of Determining Energy Savings should be presented at this time to the PA for review and approval (see Section 7.2 for details).

2403 **13.5.6 Energy Consumption Adjustment Models**

2404 Energy consumption adjustment models used in prior Reporting Periods may be used in the
2405 current Reporting Period if the following questions are answered, “yes.”

- 2406 • Has the customer continuously participated in a PA sponsored SEM program
2407 engagement since the original development of the energy consumption adjustment
2408 model (with an allowance for gaps between SEM program engagements resulting from
2409 cohort launch or other timing issues)?
- 2410 • Were energy savings values that were submitted and accepted by the CPUC for all
2411 Reporting Periods that preceded the current Reporting Period available?
- 2412 • Do the energy consumption adjustment model and energy baseline data meet the
2413 quantitative and qualitative requirements of this M&V Guide?
- 2414 • Is the Opportunity Register available and inclusive of all prior Reporting Periods for
2415 which the energy consumption adjustment model was used?
- 2416 • Have the relevant variables selected as part of the overall M&V process not changed
2417 since the prior Reporting Period?
- 2418 • Is energy consumption or relevant variables data used in the formation of an energy
2419 consumption adjustment model available at the same frequency now as it was when the
2420 model was first formed (e.g. data was and still is available on a weekly basis)?
- 2421 • Are the M&V boundaries the same as in prior Reporting Periods?

2422 If there are changes in energy consumption models or a new energy baseline is being
2423 established, then documentation that meets the requirements of Section 14.1.2 through Section
2424 14.1.7 shall be provided as part of the Mid-Year Review.

2425 **13.5.7 Opportunity Register**

- 2426 • Have any changes occurred since the last SEM Reporting Period Performance Report
2427 that would question the usefulness of the Opportunity Register?

2428 **13.5.8 Energy Management Assessment**

- 2429 • Is there any reason to believe that the next EMA as required by the Design Guide will
2430 not occur?

2431 **13.5.9 Greenhouse Gases**

- 2432 • Has the customer’s interest in understanding the GHG emissions reduction changed?

2433 **13.6 Outcomes of the Mid-Year Review**

2434 The PA will review the Mid-Year Review materials and may have follow up questions, requests
2435 for more information, or approval that the SEM program engagement is seemingly going well at
2436 this point in time.

2437 **13.7 Customer Learning and Leading**

2438 The Mid-Year Review is prepared for by the implementer and presented to the PA sponsoring
2439 the SEM program. The customer may be interested in the Mid-Year Review to better
2440 understand their own site and operations and to potentially prepare for a presentation to their
2441 management.

2442

2443

2444 **14 SEM Reporting Period Performance Report Preparation Checklist**
 2445 A SEM Reporting Period Performance Report shall be developed for each Reporting Period.

2446 **14.1 SEM Reporting Period Performance Report Requirements**
 2447 The SEM Reporting Period Performance Report shall contain the following information. The
 2448 SEM Reporting Period Performance Report may be amended with additional information at the
 2449 request of the PA or discretion of the implementer. The implementer can format the report as
 2450 needed. The implementer shall add graphics and other supporting information when justifying
 2451 changes to data or results.

2452 **14.1.1 Table of Current and Historic Energy Savings**
 2453 A table of current and historic reported energy savings along with incentives paid and to be paid
 2454 shall be placed at the beginning of the report. For this table, values for the current Reporting
 2455 Period are being newly reported by the implementer and previous Reporting Period values
 2456 should be updated to reflect values accepted by the PA and actually reported to the CPUC.

2457 Example table

SEM Program Year						
	1	2	3	4	5	6
SEM Incented Electricity Savings (kWh)						
Electricity Savings, Avoided Energy Consumption or Annualized						
Electricity Savings Method						
Peak Demand Savings (kW)						
SEM Incented Natural Gas Savings (therms)						
Natural Gas Savings, Avoided Energy Consumption or Annualized						
Natural Gas Savings Method						

SEM Incented Electricity Incentive (\$)	
Peak Demand Incentive (\$)	
SEM Incented Natural Gas Incentive (\$)	
Milestone Incentives (\$)	
Total Incentives	

2458

2459 14.1.2 SEM Time Periods (2)

- 2460 • Documentation of current SEM Program Cycle participation. (2.3.3)
- 2461 • SEM Program Cycle start and end dates. (2.1.1)
- 2462 • Time periods for the current SEM Program Cycle. Starting and ending dates for all
- 2463 Reporting Periods and Baseline Periods of the current SEM Program Cycle for each
- 2464 energy consumption adjustment model developed. (2.1.2 and 2.1.3) included in the
- 2465 energy consumption adjustment model table of Section 14.1.10.

2466 14.1.3 Site Characterization (3)

- 2467 1. The customer's business and operations characterized in a brief narrative.
- 2468 2. M&V boundaries
 - 2469 a. A description of M&V boundaries. (3.6)
 - 2470 b. Arial images or line drawings of the site with M&V boundaries provided. (3.6)
- 2471 3. Energy types
 - 2472 a. A table of all energy types that are delivered to and away from the M&V
 - 2473 boundaries with associated energy using equipment, processes, and systems. If
 - 2474 the type of energy is included in the M&V process. If the type of energy is
 - 2475 delivered away from the facility boundaries, stored on-site, is a feedstock, and is
 - 2476 generated/extracted on-site. (3.1)
 - 2477 b. A statement affirming that the customer is supplied with non-utility (non-IOU)
 - 2478 fuels or not. (3.1.1.1)
 - 2479 i. If applicable, a description of the non-utility energy present at the site.
 - 2480 c. A statement affirming if the customer does or does not have on-site generation.
 - 2481 (3.1.1.1)
 - 2482 i. If applicable, a description of the on-site generation equipment and use.
 - 2483 ii. If applicable, a description of how the M&V boundaries were modified to
 - 2484 account for on-site generation. (3.1.1.1)
 - 2485 d. A statement and analysis supporting decision to omit any energy types from the
 - 2486 M&V process. (3.1.1.2)
- 2487 4. Energy meters
 - 2488 a. A table of all utility and other energy meters and submeters for all types of energy
 - 2489 with unique identifiers, associated units and metering interval, and all major
 - 2490 processes monitored. (3.3)
 - 2491 b. A list of equations and conversion factors used to measure energy consumption.
 - 2492 (3.3)
- 2493 5. Energy flows
 - 2494 a. An energy flow drawing. (3.4)

- 2495 6. Energy Map
- 2496 a. As a separate document referred to in the SEM Reporting Period Performance
- 2497 Report or as part of the SEM Reporting Period Performance Report: The Energy
- 2498 Map. (3.5)
- 2499 7. Statement of current energy performance improvement targets or energy savings goals
- 2500 8. A statement of how the customer is engaged in the site characterization process.
- 2501 14.1.4 Relevant Variables (4)
- 2502 1. A table of potential relevant variables including associated data sources, energy types
- 2503 expected to be affected by the variables, and rational for inclusion in the Energy Data
- 2504 Collection Plan. (4.1 and 4.2)
- 2505 2. Notation on the list of potential relevant variables or a separate list of relevant variables
- 2506 selected for data will be collected. (4.2)
- 2507 3. A statement of how the customer is engaged in the relevant variable selection process.
- 2508 14.1.5 Energy Data Collection (5)
- 2509 1. As a separate document referred to in the SEM Reporting Period Performance Report or
- 2510 as part of the SEM Reporting Period Performance Report: The Energy Data Collection
- 2511 Plan. (5.1)
- 2512 o Energy meters (5.1.1)
- 2513 o Relevant variable sources (5.1.1)
- 2514 o For each data source: how to be collected, frequency of data collection, data
- 2515 storage method and location, person(s) responsible for collecting and storing
- 2516 data, person(s)
- 2517 o A statement confirming that non-utility energy meters are calibrated
- 2518 appropriately. (5.1.1.3)
- 2519 2. A statement describing the review and any updates to the Energy Data Collection Plan
- 2520 (5.1.2)
- 2521 3. Energy Data and Performance Tracking Tool (5.2)
- 2522 o As a separate document referred to in the SEM Reporting Period Performance
- 2523 Report or as part of the SEM Reporting Period Performance Report: The Energy
- 2524 Data and Performance Tracking Tool.
- 2525 4. Opportunity Register (5.3)
- 2526 o As a separate document referred to in the SEM Reporting Period Performance
- 2527 Report or as part of the SEM Reporting Period Performance Report: The
- 2528 Opportunity Register.
- 2529 5. A statement of how the customer is engaged in the energy data collection process.
- 2530 14.1.6 Collecting Data and Assessing Data Quality (6)
- 2531 1. A statement if there were or were not issues related to implementing the Energy Data
- 2532 Collection Plan. (6.1)
- 2533 2. A statement if there were or were not changes made to the data set. (6.2)
- 2534 a. If applicable, a statement of the reason and description of any changes to the
- 2535 data set.
- 2536 3. A statement if there were or were not data removed as outliers or anomalous data. (6.2)
- 2537 a. If applicable, a description of the strategy used to remove outliers or anomalous
- 2538 data.
- 2539 4. A statement if time-series adjustments were or were not made to the data. (6.3)
- 2540 a. If applicable, a description of the analysis for the decision to use a time-series
- 2541 adjustment.
- 2542 5. A statement of how the customer is engaged in the data collection and quality
- 2543 assessment process.

2544 14.1.7 Energy Consumption Adjustment Modeling (7)

2545 For each type of energy included in the M&V process

- 2546 1. A statement of energy savings method (top-down or bottom-up to be used. (7.2)
- 2547 a. If applicable, as a separate document referred to in the SEM Reporting Period
- 2548 Performance Report or as part of the SEM Reporting Period Performance Report
- 2549 a Notification of Bottom-up Method of Determining Energy Savings. (7.2)

2550 For each developed energy consumption adjustment model used to determine Site-wide Energy

2551 Savings:

- 2552 1. A statement if the energy consumption adjustment model used was developed and used
- 2553 as part of a previous Reporting Period. (7.12)
- 2554 a. If applicable, list all prior Reporting Periods that the energy consumption
- 2555 adjustment model was used for.
- 2556 2. Image of scatter diagrams of energy consumption and each relevant variable used in the
- 2557 model or clear instructions where to find such diagrams in the Energy Data and
- 2558 Performance Tracking Tool or Energy Consumption Adjustment Model Development
- 2559 Tool. (7.5)
- 2560 3. A statement if the energy baseline was or was not modified in any way. (7.6)
- 2561 a. If applicable, a description of the rationale and how the energy baseline was
- 2562 modified.
- 2563 4. As a separate document referred to in the SEM Reporting Period Performance Report or
- 2564 as part of the SEM Reporting Period Performance Report: The Table of Competing
- 2565 Models. (7.8.4)
- 2566 5. Identification of which model was selected for use in calculating Site-wide Energy
- 2567 Savings. (7.9)
- 2568 6. A statement of the rational for selecting energy consumption adjustment models that will
- 2569 be used to determine Site-wide Energy Savings. (7.9)
- 2570 7. A statement confirming if or if not ongoing confirmation of model validity was conducted
- 2571 and at what frequency (7.10)
- 2572 a. The statement should confirm that the listed questions in section 7.10 were
- 2573 included and addressed in the ongoing confirmation of model validity.
- 2574 8. A statement if or if not individual intervals in the Reporting Period were flagged as having
- 2575 relevant variables data points outside allowed bounds of the energy baseline data set.
- 2576 (7.10)
- 2577 a. If applicable, a statement of how these intervals were addressed along with clear
- 2578 instructions where to find relevant data entries in the Energy Data and
- 2579 Performance Tracking Tool or Energy Consumption Adjustment Model
- 2580 Development Tool.
- 2581 9. A statement of the methods used to identify the presence of non-routine events.
- 2582 (7.11.1.1)
- 2583 10. A statement if non-routine events were or were not identified. (7.11.1.1)
- 2584 a. If applicable, a description of the non-routine events and methods and rational for
- 2585 use of the method used for making non-routine adjustments.
- 2586 11. If applicable, a statement of the rational for why backcast normalization was used rather
- 2587 than a bottom-up approach of aggregating energy savings from individual EPIAs.
- 2588 12. A statement of how the customer is engaged in the energy consumption adjustment
- 2589 modeling process.

2590 14.1.8 Monitoring Energy Performance (8)

- 2591 1. For each type of energy included in the M&V process, a plot of actual and predicted
- 2592 energy consumption that spans the Baseline Period and all Reporting Periods (current

and historic) for which the energy consumption adjustment model has been used. This plot may either be in the SEM Reporting Period Performance Report or part of the Energy Data and Performance Tacking Tool with clear instructions where to find the plot. (8.1)

2. A statement confirming if the customer and implementer together did or did not review the Opportunity Register to ensure that EPIAs were being implemented and energy savings were calculated and were within reason of what was expected. (8.2)
3. As a separate document referred to in the SEM Reporting Period Performance Report or as part of the SEM Reporting Period Performance Report, for each EPIA being included as part of a bottom-up calculation for energy savings for regulatory reporting:
 - a. The method and analysis used to determine annualized and Avoided Energy Consumption Energy Savings for EPIAs (8.2.1 and 8.2.2)
 - b. The method and analysis used to determine if the EPIA was identified and planned outside of a SEM Program Cycle. (8.2.3)
4. For each type of energy included in the M&V process for which energy consumption adjustment models were used to report energy savings, identify the EPIAs for which energy savings were removed from the model based energy savings.
5. A statement of how the customer is engaged in the energy performance monitoring process.

14.1.9 Calculating Site-wide Energy Savings with Energy Consumption Adjustment Models (9)

For each type of energy included in the M&V process:

1. A CUSUM plot with annotation and footnotes that spans the Baseline Period and all Reporting Periods (current and historic) for which the energy consumption adjustment model has been used. This plot may also be either be in the SEM Reporting Period Performance Report or part of the Energy Data and Performance Tacking Tool but must be replicated in this report. (8.1)
2. A statement indicating if energy savings will be reported on an Avoided Energy Consumption or annualized basis for the current Reporting Period.
3. If annualized energy savings are being reported:
 - a. A statement of the rational for annualization and that the PA has approved annualization. (9.5)
 - b. If applicable, a statement that the Reporting Period will be divided to accommodate seasonality and,
 - c. A statement of the start and end date of the Annualization Period. (9.5.2)
 - d. If applicable, a statement with the rationale for an Annualization Period longer than 120 days. (9.5.2)
 - e. If applicable, a statement with the rationale for an Annualization Period that ends prior to the end of the Reporting Period. (9.5.2)
 - f. If applicable, a statement and analysis of how outliers were addressed in the Annualization Period. (9.5.3)
4. A statement how the customer is engaged in the energy savings calculation process.

14.1.10 Reported Energy Savings (10)

For each type of energy included in the M&V process:

1. For each type of energy, a table listing current Reporting Period Avoided Energy Consumption Site-wide Energy Savings, Non-SEM Program Energy Savings, SEM Program Energy Savings, SEM Incented Energy Savings, and SEM Non-incented Project Energy Savings. (10.2)

2. As part of the SEM Reporting Period Performance Report or in another document, non-utility supplied energy (non-IOU fuels) analysis,
3. If applicable, annualized energy savings value being reported.
4. For each energy type for which a bottom-up approach is being used, a table identifying the EPIAs for which energy savings are being claimed which can be used to connect to the Opportunity Register.
 - a. For each EPAI, the pro-rated energy savings value to claim in the current Reporting Period from the previous Reporting Period (if applicable)
 - b. For each EPAI, the pro-rated energy savings value to claim in the current Reporting Period from the current Reporting Period
 - c. For each EPAI, the pro-rated energy saving value to claim in the next Reporting Period (this will be 0 if the PA has given permission to report savings using an annualized basis).
5. For each energy consumption adjustment model currently being used or used in previous Reporting Periods, a table listing historic and current Reporting Period energy savings.
 - a. If applicable, a statement detailing the rational for claiming the unrealized energy savings.

Example table to be completed for each energy consumption adjustment model.

Energy Type [Name] – [Model Name]

	SEM Program Year					
	1	2	3	4	5	6
Baseline Period Start and End Date						
Reporting Period Start and End Date						
Predicted Energy Consumption						
Actual Energy Consumption						
Are Energy Savings Annualized or Not (Y/N)						
Cumulative Site-wide Energy Savings						
Incremental Site-Wide Energy Savings						
Non-SEM Program Energy Savings						
SEM Program Energy Savings						
SEM Incented Energy Savings						
SEM Non-incented Project Energy Savings						
Unrealized Energy Savings from Prior Reporting Period						

14.1.11 Calculating Demand Savings (11)

1. A statement confirming if electricity demand savings are being reported or not.
2. If applicable, a statement describing the method used to determine electricity demand savings.
3. If applicable, documentation or provision of the tool used to determine electricity demand savings.
4. If applicable, the calculated electricity demand savings.

2669 5. A statement of how the customer is engaged in the demand savings calculation process.

2670 **14.1.12 Greenhouse Gas Savings (12)**

- 2671 1. A statement if the customer did or did not want to discuss GHG inventories, reporting,
2672 reduction calculations, or other related topics. (12.5)
- 2673 2. If applicable, a statement confirming if the customer does or does not have a GHG
2674 emissions reduction target and description of the GHG emission reduction target if they
2675 have one. (12.5)
- 2676 3. If applicable, a statement regarding any voluntary or required GHG related programs the
2677 customer is currently or may participate in. (12.5)
- 2678 4. If applicable, listing of calculated energy-related GHG emissions reductions with proper
2679 labeling. (12.5)
- 2680 5. A statement of how the customer is engaged in the GHG savings calculation process.

2681 **14.1.13 Design Guide Summaries**

2682 Attach all summaries detailed in the Design Guide at the end of the SEM Reporting Period
2683 Performance Report. Not all summaries are developed each SEM Program Cycle or SEM
2684 Program Year. These summaries include but are not limited to:

- 2685 • Scoping Summary
- 2686 • EMA Summary
- 2687 • SEU Definition Summary
- 2688 • Treasure Hunt Summary
- 2689 • Cycle Decision and Transition Summary
- 2690 • Educational Activity Summary

2691 **14.2 Customer Learning and Leading**

2692 The SEM Reporting Period Performance Report is prepared for by the implementer and
2693 presented to the PA sponsoring the SEM program. The customer may be interested in the SEM
2694 Reporting Period Performance Report to better understand their own site and operations and to
2695 potentially prepare for a presentation to their management.

References

- Andrew Bernath and Maggie Buffum, Estimating Energy Savings Resulting from Strategic Energy Management Programs: Methodology Comparison, 2017 International Energy Program Evaluation Conference, Baltimore, MD
- ASHRAE Guideline 14:2014 – Measurement of Energy, Demand and Water Savings
- Bonneville Power Administration, Commercial & Industrial Strategic Energy Management Measurement & Verification Reference Guide, Revision 1.0, March 31, 2022
- California Air Resources Board, Cal e-GGRT, Accessed May 2022, <https://ssl.arb.ca.gov/Cal-eGGRT/login.do>
- California Air Resources Board, Mandatory GHG Reporting – Guidance Documents, Accessed May 2022, <https://ww2.arb.ca.gov/mrr-guidance>
- California Public Utilities Commission (CPUC), Energy Efficiency Savings Eligibility at Sites with non-IOU Supplied Energy Sources – Guidance Document, Version 1.1, November 2015
- Consortium for Energy Efficiency (CEE), CEE Strategic Energy Minimum Elements, February 2014
- Earni, S. and Therkelsen, P., Non-routing adjustments – towards standardizing M&V approach for quantifying the effects of static factors. 2020. Presented at the ECEEE Industrial Summer Study, virtual event, DOI 10.20357/B71W20
- Efficiency Evaluation Organization (EVO), International Performance Measurement and Verification Protocol (IPMVP) – Core Concepts, March 2022.
- Efficiency Valuation Organization (EVO), IPMVP Application Guide on Non-routine Events & Adjustments, 2020
- Energy Trust of Oregon Energy Production Efficiency, Energy Intensity Modeling Guideline, Version 2.2, January, 2019
- Intergovernmental Panel on Climate Change (IPCC), Climate Change 2022 Impacts, Adaptation, and Vulnerability Summary for Policymakers, Accessed May 2022, https://www.ipcc.ch/report/ar6/wg2/downloads/report/IPCC_AR6_WGII_FinalDraft_FullReport.pdf
- ISO 50001:2018 – Energy management systems – Requirements with guidance for use
- ISO 50015:2014 – Measurement and verification of energy performance of organizations – General principles and guidance
- ISO 50047:2016 – Determination of energy savings in organizations
- NW SEM Collaborative, SEM Energy Modeling Method Selection Guide, 2019
- Philipp Degens and Anna Kelly, Strategic Energy Management Modeling: What’s good enough?, 2017 International Energy Program Evaluation Conference, Baltimore, MD
- SBW Consulting Inc., Group D – D11.03 2018-19 Industrial Strategic Energy Management (SEM) Impact Evaluation, January 2022
- SBW Consulting Inc., Uncertainty Approaches and Analyses for Regression Models and ECAM, 2017
- Science Based Targets initiative (SBTi), Set a Target, Accessed May 2022, <https://sciencebasedtargets.org/set-a-target>
- U.S. Environmental Protection Agency, EPA Center for Corporate Climate Leadership, Accessed May 2022, <https://www.epa.gov/climateleadership>
- U.S. Department of Energy Superior Energy Performance 50001, SEP 50001, Measurement & Verification Protocol: 2019, October 29, 2019
- World Business Council for Sustainable Development and World Resources Institute, The Greenhouse Gas Protocol – A Corporate Accounting and Reporting Standard, March 2004

Acknowledgements

This M&V Guide was authored by Peter Therkelsen on behalf of Raven Energy Consulting under contract to Sergio Dias Consulting.

Thanks to the Energy Trust of Oregon, Bonneville Power Administration, and U.S. Department of Energy for producing comprehensive and publicly available M&V Guides. M&V Guides from these organizations are foundational to this M&V Guide, which has been tailored to the specific context of the California SEM programs. Many elements developed for this document were based on those documents and adapted with permission. Without the public availability of these resources this M&V Guide would be far less comprehensive.

Thanks to the staff of the California Public Utilities Commission, Pacific Gas and Electric, San Diego Gas and Electric, Southern California Gas, and Southern California Edison who have provided their expertise, knowledge, and made available their contractors' time to support the revision of this M&V Guide. PA and CPUC contractors include staff from Cascade Energy, CleaResult, Energy 350, kW Engineering, Leidos, and EPS. Special thanks to Stillwater Energy whose staff provided contextualized answers to foundational questions.

Thanks to the individuals that contributed comments and input through the original public review process.

Annex A - Terminology

For the purposes of this M&V Guide, the following terms and definitions apply.

This terminology guide is focused on providing clarity to assist the establishment of the M&V process. Statistical tests are not defined as detailed understanding of the meaning of these test is not required of the customer and competent implementers should already be familiar with these terms. Additionally, these terms are well established in authoritative and easily obtained statistics reference manuals.

Annualization Period: defined period of time selected for the annualization of energy savings
Additional specification provided in Section 2.1.4

Avoided Energy Use

Avoided Energy Consumption: Avoided Energy Use is the amount of energy (or peak demand) that was not consumed or realized as a result of the energy efficiency project or program intervention. Avoided energy use is the difference between actual energy consumption in the “reporting period” and the consumption that is forecast for the same period using the “baseline energy consumption model,” and where the baseline energy consumption model use is adjusted to reflect reporting period conditions. The Avoided Energy Use approach is used as the basis of customer incentive calculations and embedded M&V reporting of savings.

Source: CPUC NMEC Rulebook version 2.0

Additional specifications provided in Section 1.4

Baseline Period: Specific period of time before the implementation of an energy performance improvement action selected for comparison with the Reporting Period and the calculation of the energy performance and of energy performance improvement

Source: ISO 50015:2014, 3.1

Additional specifications provided in Section 2.1.3

Behavioral: Behavioral activities provide energy savings from interventions that result in changes in actions by customers with respect to energy usage in a building. Behavioral activities consist of actions such as manually turning off lights and equipment, adjusting blinds, reducing water use and so on.

Source: CPUC NMEC Rulebook version 2.0

Boundary: physical or organizational limits

Example: A process; a group of processes; a site; multiple sites under the control of an organization, or an entire organization

Source: ISO 50001:2018, 3.1.3 - modified (removed Note 1)

BRO: The combination of behavioral, retrocommissioning, and operational activities

2805 **Energy:** electricity, fuels, steam, heat, compressed air, and other like media
2806 Note 1: for the purposes of this Guide, energy refers to the various types of energy, which can
2807 be purchased, stored, treated, used in equipment or in a process, or recovered.
2808 Source: ISO 50001:2018, 3.5.1 - modified (replaced “International Standard” with “this Guide”,
2809 and removed “including renewable” in Note 1)
2810
2811 **Energy baseline:** quantitative reference(s) providing a basis for comparison of energy
2812 performance
2813 Note 1: An energy baseline is based on data from a specified period of time and/or conditions,
2814 as defined by the organization
2815 Note 2: Energy baselines are used for determination of energy performance improvement, as a
2816 reference before and after, or with and without implementation of energy performance
2817 improvement actions.
2818 Source: ISO 50001:2018, 3.4.7
2819
2820 **Energy consumption:** quantity of energy applied
2821 Source: ISO 50001:2018, 3.5.2
2822
2823 **Energy efficiency:** ratio or other quantitative relationship between an output of performance,
2824 service, goods, commodities, or energy, and an input of energy
2825 **Source:** ISO 50001:2018, 3.5.3 – modified (removed examples and Note 1)
2826
2827 **Energy export:** The quantity of energy delivered away from the M&V boundary such that the
2828 site is not be counted as a net negative consumer of energy
2829 Source: Modified from SEP 50001 M&V Protocol, 2019
2830
2831 **Energy management system:** management system to establish an energy policy, objectives,
2832 energy targets, action plans and process(es) to achieve the objectives and energy targets
2833 Source: ISO 50001:2018, 3.2.2
2834
2835 **Energy performance:** measurable result(s) related to energy efficiency, energy use, and
2836 energy consumption
2837 Note 1: Energy performance can be measured against the organization’s objectives, energy
2838 targets and other energy performance requirements.
2839 Note 2: Energy performance is one component of the performance of the energy management
2840 system
2841 Source: ISO 50001:2018, 3.4.3
2842

2843 **Energy performance improvement:** improvement in measurable results of energy efficiency,
2844 or energy consumption related to energy use, compared to the energy baseline

2845 Note 1: This M&V Guide uses energy savings as the indicator of energy performance
2846 improvement.

2847 Source 50001:2018, 3.4.6 – modified (added note)

2848

2849 **Energy performance improvement action:** action or measure or group of action or measures
2850 implemented or planned within an organization intended to achieve energy performance
2851 improvement through technological, managerial or operational, behavioral, economical, or other
2852 changes

2853 Note 1: Energy performance improvement actions includes both BRO and capital projects.

2854 Source: ISO 50015:2014, 3.3 – modified (added note)

2855

2856 **Energy product:** Any excess energy delivered away from the M&V boundaries after a net zero
2857 level of energy consumption is reached

2858 Source: Modified from SEP 50001 M&V Protocol, 2019

2859

2860 **Energy target:** quantifiable objective of energy performance improvement

2861 Source: ISO 50001:2018, 3.4.15

2862

2863 **Energy use:** application of energy

2864 Examples: ventilation; lighting; heating; cooling; transportation; data storage; production process

2865 Note 1: Energy use is sometimes referred to as “energy end-use”

2866 Source: ISO 50001:2011, 3.5.4

2867

2868 **Feedstock:** raw or unprocessed material used as an input to a manufacturing process to be
2869 converted to a product

2870 Example: crude oil used to produce petroleum products

2871

2872 **Measurement and verification (M&V):** process of planning, measuring, collecting data,
2873 analyzing, verifying, and reporting energy performance or energy performance improvement for
2874 defined M&V boundaries

2875 Source: ISO 50015:2014, 3.11

2876

2877 **M&V boundary:** organizational, physical, site, site, equipment, systems, process or activity
2878 limits within which energy performance or energy performance improvement is measured and
2879 verified

2880 Source: ISO 50015:2014, 3.12

2881

2882 **Natural resources:** Energy delivered to the M&V boundaries that is not supplied by an
 2883 organization

2884 Examples: sunlight, natural gas from an on-site well, geothermal

2885 Source: Modified from SEP 50001 M&V Protocol, 2019

2886

2887 **Non-routine adjustment:** adjustment made to the energy baseline or Reporting Period energy
 2888 consumption to account for unusual changes in relevant variables or static factors, outside the
 2889 changes accounted for by normalization

2890 Note 1: non-routine adjustments may apply where the energy baseline or Reporting Period no
 2891 longer reflects energy use or energy consumption patterns, or there have been major changes
 2892 to the process, operational patterns, or energy using systems

2893 Source: ISO 50015:2014, 3.16 – modified (added, “or Reporting Period energy consumption”)

2894

2895 **Non-SEM Program Energy Savings:** Energy savings calculated for EPIAs identified and
 2896 planned outside of any SEM Program Cycle and implemented during the current Reporting
 2897 Period, whether receiving other incentives or not.

2898 Definition also provided in Section 10.2

2899

2900 **Normalization:** modification of data to account for changes to enable comparison of energy
 2901 performance under equivalent conditions

2902 Source: ISO 50001:2018, 3.4.10

2903

2904 **Operational Activities:** Control-based; they improve or adjust existing controls to optimize
 2905 equipment performance. Operational activities include maintaining room temperature set points,
 2906 revising equipment operating schedules consistent with current building occupancy schedule,
 2907 and changing equipment set points in response to current weather conditions.

2908 Source: CPUC NMEC Rulebook version 2.0

2909

2910 **Relevant variable:** quantifiable factor that affects energy performance and routinely changes

2911 Note 1: Significance criteria are determined by the organization

2912 Note 2: Other commonly terms for relevant variables include independent variable and energy
 2913 driver

2914 Examples: Weather conditions, operating conditions (indoor temperature, light level), working
 2915 hours, production output

2916 Source: ISO 50001:2018, 3.4.9 – modified (added Note 2)

2917

2918 **Reporting Period:** defined period of time selected for calculation and reporting of energy
 2919 performance

2920 Source: ISO 50001:3.17, 3.17

2921 Additional specifications provided in Section 2.1.2

2922

2923 **Retrocommissioning:** A systematic process of identifying and implementing operational and
 2924 maintenance improvements to achieve the design intentions consistent with the current usage
 2925 of a building. The process is designed to improve the performance of building subsystems as
 2926 well as optimize the performance of the overall system. Retrocommissioning focuses on
 2927 operations and maintenance improvements and diagnostic testing, although major repairs and
 2928 equipment upgrades may be identified and recommended through the process. Minor repairs
 2929 required to conduct diagnostic testing may also be implemented.

2930 Behavioral, Operational, Maintenance and Repair measures may be identified and carried out
 2931 during a retrocommissioning project. Behavioral, operational and maintenance activities may
 2932 also be implemented separately as "operations and maintenance" projects in existing buildings.

2933 Source: CPUC NMEC Rulebook version 2.0

2934

2935 **SEM Incented Energy Savings:** SEM Program Energy Savings minus SEM Non-incented
 2936 Project Energy Savings.

2937 Additional specification provided in Section 10.2

2938

2939 **SEM Non-incented Project Energy Savings:** Energy savings for an EPIA (project) identified
 2940 during any SEM Program Cycle and implemented during the current Reporting Period that is to
 2941 receive an incentive from another PA program.

2942 Additional specification provided in Section 10.2

2943

2944 **SEM Program Cycle:** 24 month period that distinguishes each "cycle" detailed in the SEM
 2945 Program Design Guide. There are three "cycles" in the SEM Program Design Guide.

2946 Additional specifications provided in Section 2.1.1

2947

2948 **SEM Program Energy Savings:** Site-wide Projected Energy Savings minus Non-SEM Program
 2949 Energy Savings

2950 Additional specification provided in Section 10.2

2951

2952 **Site-wide Energy Savings:** Incremental energy savings for a given type of energy resulting
 2953 from the aggregation of energy savings from each energy consumption adjustment model
 2954 developed for the same energy type.

2955 Additional specification provided in Section 10.2

2956

2957 **Static factor:** Identified factor that impacts energy performance and does not routinely change

2958 Example 1 Examples of static factors may include site size, design of installed equipment, the
 2959 number of weekly production shifts, the number or type of occupants, range of products

2960 Example 2 An example of a change in a static factor could be a change in a manufacturing
 2961 process raw material from aluminum to plastic may lead to a non-routine adjustment.

2962 Source: ISO 50015, 3.20

2963 **Strategic Energy Management (SEM):** A holistic approach to managing energy consumption
2964 in order to continuously improve energy performance, by achieving persistent energy and cost
2965 savings over the long term. SEM focuses on business practice change from senior management
2966 through shop floor staff, affecting organizational culture to reduce energy waste and improve
2967 energy intensity. SEM emphasizes equipping and enabling plant management and staff to
2968 impact energy consumption through behavioral and operational change. While SEM does not
2969 emphasize a technical or project centric approach, SEM principles and objectives may support
2970 capital project implementation.

2971 Source: CEE SEM Minimum Element – modified (replaced energy use with consumption)

2972

2973

2974 **Annex B – Relationship of 50001 Ready Navigator Tasks and M&V Guide**
 2975 **Sections**

2976 The below table highlights the relationship of 50001 Ready Navigator Tasks to sections of this
 2977 M&V Guide.

M&V Guide Section	50001 Ready Navigator Task
3 – Characterizing the Site	3 – Scope and Boundaries
	8 – Energy Data Collection and Analysis
	9 – Significant Energy Uses
	21 – Monitoring and Measurement of Energy Performance Improvement
4 – Relevant Variables	8 – Energy Data Collection and Analysis
5 – Energy Data Collection Plan	8 – Energy Data Collection and Analysis
	10 – Improvement Opportunities
	11 – Energy Performance Indicators and Energy Baselines
	21 – Monitoring and Measurement of Energy Performance Improvement
6 – Collecting Data and Assessing Data Quality	8 – Energy Data Collection and Analysis
7 – Energy Consumption Adjustment Modeling	11 – Energy Performance Indicators and Energy Baselines
8 – Monitor Energy Performance	21 – Monitoring and Measurement of Energy Performance Improvement
9 – Calculating Site-wide Energy savings with Energy Consumption Adjustment Models	11 – Energy Performance Indicators and Energy Baselines
	21 – Monitoring and Measurement of Energy Performance Improvement
10 – Preparing Energy Savings for Regulatory Reporting	21 – Monitoring and Measurement of Energy Performance Improvement
11 – Calculating Demand Savings	11 – Energy Performance Indicators and Energy Baselines
	21 – Monitoring and Measurement of Energy Performance Improvement
12 – Greenhouse Gas Savings	11 – Energy Performance Indicators and Energy Baselines
13 – Mid-Year Review of the M&V Process and Results	22 – Internal Audit
	23 – Management Review
14 – SEM Reporting Period Performance Report Preparation Checklist	22 – Internal Audit
	23 – Management Review

2978

Annex C - Special Cases in Energy Accounting

The below scenarios are provided as examples and are not requirements of this M&V Guide. Current PA and CPUC policies should be reviewed and used throughout the M&V process.


Energy Accounting of Energy Export and Energy Product

Energy delivered away from the M&V boundaries shall be accounted for as either an energy export or energy product.

Energy Export

The maximum allowable amount of energy export is equal to the quantity of energy delivered into the site boundary of the same energy type such that a net zero level is reached on a delivered energy basis. A site may not be counted as a net negative consumer of any energy type.

EXAMPLE: A site purchases 30 GWh of grid electricity and produces 25 GWh of electricity with on-site photovoltaic (PV) panels. The site consumes 45 GWh and delivers 10 GWh away from the M&V boundaries. The 10 GWh delivered away from the M&V boundaries is treated as energy export. See figure below.

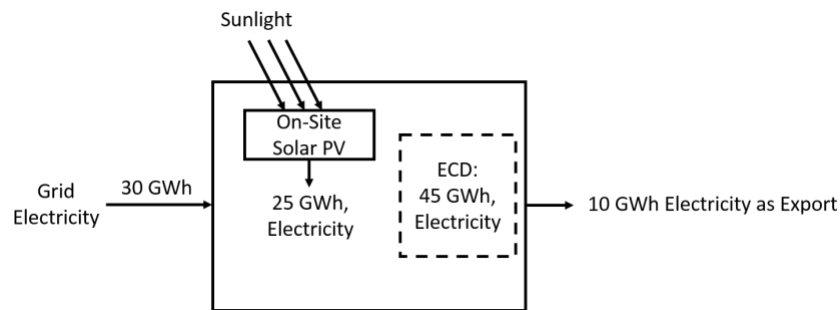


$$\text{Delivered Energy} = 30 \text{ GWh} + 25 \text{ GWh} - 10 \text{ GWh} = 45 \text{ GWh}$$

Energy Product

For each energy type, if a net zero level is reached on a delivered energy basis, any excess energy delivered away from the M&V boundaries is accounted for as an energy product. This may result from a site producing large quantities of on-site energy. Energy product shall be considered as a relevant variable for adjustment models.

EXAMPLE: A site purchases 30 GWh of grid electricity and generates 100 GWh of electricity with on-site wind turbines. The site consumes 55 GWh and delivers 75 GWh away from the M&V boundaries. A maximum quantity of 30 GWh is treated as energy export. The remaining 45 GWh is treated as energy product. See figure below.

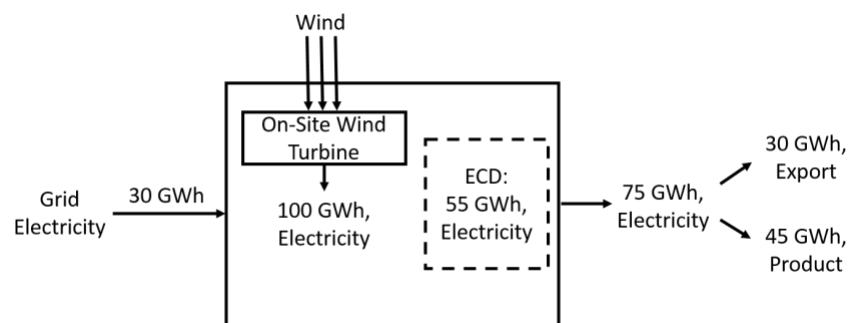

3007 Delivered Energy = 30 GWh + 100 GWh – 30 GWh – 45 GWh = 55 GWh


3008

3009 **On-site Extraction or Generation of Energy from Natural Resources**

3010 Energy from natural resources that are delivered into and consumed within or delivered away
3011 from the M&V boundaries shall be included in the energy accounting. The point at which on-site
3012 extracted or generated energy is metered and accounted for may be selected by the
3013 organization so long as it is at a reasonable point along the extraction or generation process
3014 flow (e.g., a site may choose to meter biogas flow and energy content or the resulting electricity
3015 and hot water generated from the utilization of the same biogas). This measurement point shall
3016 be consistent between the baseline and Reporting Periods. This allowance is made recognizing
3017 that the quantity of energy of some natural resources (e.g., photons or wind) or the energy
3018 derived thereof (e.g., biogas) may be difficult to meter. In such cases, the quantity of energy
3019 generated within the M&V boundaries from the natural resource (e.g., AC electricity from the
3020 inverter of a PV panel system) may be metered and included in the energy accounting.

3021 NOTE: While metering energy at a point along the extraction or generation process flow
3022 downstream of the M&V boundaries may be simpler and more cost effective (e.g. metering hot
3023 water produced from a biogas fired boiler, rather than the biogas produced from a sewage fed
3024 digester), the effect of energy performance improvement actions implemented upstream of the
3025 point of metering may not be reflected in the calculated site-wide energy performance
3026 improvement.

3027 EXAMPLE: A wastewater treatment site uses sewage to generate biogas, which is used to
3028 generate electricity and steam in a CHP system. The site also purchases grid electricity, and
3029 generates on-site electricity with an array of PV panels. As the site cannot cost-effectively install
3030 meters to measure biogas flow and energy content, the site decides to meter the electricity and
3031 steam coming out of the CHP system for energy accounting purposes. In one month, the biogas
3032 CHP system produces 60 GWh of electricity and 100 MMBTU of steam. The site purchases 50
3033 GWh of grid electricity and generates 40 GWh of on-site electricity with the PV panels. The site
3034 consumes 85 GWh of electricity and delivers 65 GWh of electricity away from the M&V
3035 boundaries. The site consumes 80 MMBTU of steam and delivers 20 MMBTU away from the
3036 M&V boundaries. See figure below.

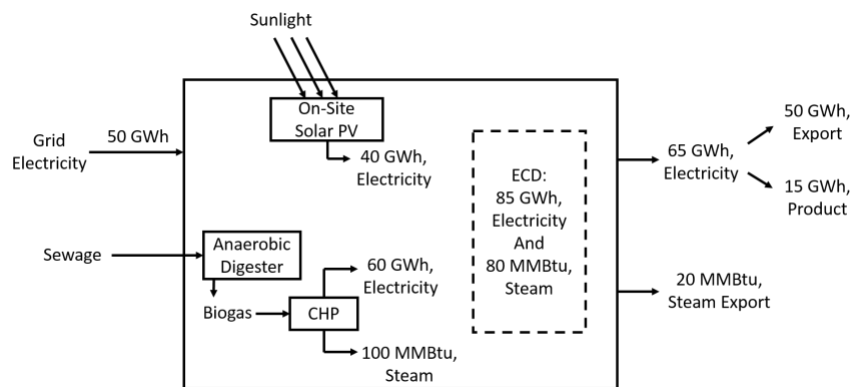

3037

3038 Electricity: Delivered Energy = 50 GWh + 60 GWh + 40 GWh – 50 GWh – 15 GWh = 85 GWh

3039 Steam: Delivered Energy = 100 MMBtu – 20 MMBtu = 80 MMBtu

3040 **Feedstock and Resulting Energy Types**

3041 In some instances, energy delivered to the M&V boundaries may be used as a feedstock rather
3042 than consumed as energy. The portion of an energy type used as a feedstock shall be

3043 subtracted from the delivered energy. The commodity that is being produced from the feedstock
3044 shall be considered as a relevant variable in the energy consumption adjustment model.

3045 Any energy types resulting from the processing of feedstock (e.g., process gas produced during
3046 the refining process, heat generated by an exothermic reaction, biogas generated from sewage)
3047 that are consumed within or delivered away from the M&V boundaries shall be included in the
3048 energy accounting.

3049 EXAMPLE: A site purchases 1000 Therms of natural gas and uses 750 Therms to produce
3050 hydrogen, which is sold as a commodity, while consuming the other 250 Therms within the site
3051 boundary in a boiler. The energy accounting shall include 250 Therms. The production quantity
3052 of hydrogen shall be considered as a relevant variable in the energy consumption adjustment
3053 model.

3054
3055
3056
3057

Annex D – Bottom Up EPIA Calculation Effort

In 2022 a joint PA working group submitted a table detailing the level of effort that should be used when calculating energy savings resulting from individual EPIAs. This table was reviewed by a larger stakeholder group of PA staff and contractors and CPUC staff and contracted evaluators. The table is provided as reference below.

	EPIA Electric Savings	EPIA Gas Savings	Baseline/Implementation Verification Techniques	Examples (not exhaustive or exclusive)
Notes: Implementers will follow these guidelines to the best of their ability. In cases where supporting information is not available or is not reasonably obtainable, the implementer will provide an explanation and substitute whatever information is available. All savings calculations will be provided in an unlocked excel spreadsheet or PA approved tool.				
A	Less than 50,000 kWh	Less than 25,000 Therms	<p>Process: Collect information for calculations by phone or email from operators, contractors, and/or suppliers. Pre or post inspection not required.</p> <p>Supporting Information: None required, although it is recommended to try to collect documentation that would provide support that the project was completed, such as photos of equipment, nameplates, setpoints, gauges, screenshots from control systems (such as SCADA or EMIS). List pre and post conditions, setpoints, and equipment specifications where applicable. Confirm annual hours of runtime through conversations with site personnel, control systems, logs, or trends, and list the source if applicable. Provide clear description of the location of upgrade.</p> <p>Calculation Approach: Simple calculation methods using engineering judgement.</p>	HVAC adjustments; compressed air leak repair; automation controls; reduce lighting levels; steam trap repair and replacement
B	50,000 kWh to 150,000 kWh	25,000 Therms to 50,000 Therms	<p>Process: Collect information for calculations by phone or email from operators, contractors, and/or suppliers. If helpful, consider a site visit but it is not required.</p> <p>Supporting Information: If available confirm quantities, schedule, setpoints, loading, performance improvement, performance issues. If possible/practical, collect photos of equipment,</p>	Adjust air compressor setpoints; dryer controls; lighting controls; lighting upgrade to LED; compressed air leak repair; VFDs; HVAC schedules and setbacks; shut off equipment when not in use

	EPIA Electric Savings	EPIA Gas Savings	Baseline/Implementation Verification Techniques	Examples (not exhaustive or exclusive)
			<p>nameplates, setpoints, gauges, screenshots from control systems (such as SCADA or EMIS). List pre and post conditions, setpoints, and equipment specifications where applicable. Confirm annual hours of runtime through conversations with site personnel, control systems, logs, or trends, and list the source if applicable. Provide clear description of the location of upgrade.</p> <p>Calculation Approach: Calculations will use collected site information and engineering judgement.</p>	
C	150,000 kWh to 500,000 kWh	50,000 Therms to 200,000 Therms	<p>Process: If information for calculations may be adequately collected by phone and email from operators, contractors, and/or suppliers, no site visit required. Otherwise, visit site to collect the information. A pre-inspection visit is not required.</p> <p>Supporting Information: Use spot measurements, short term interval monitoring, or data from end user or vendors, as appropriate, to supplement information from operators, contractors, and suppliers. Datalogging is encouraged though not required. If available, confirm quantities, schedule, setpoints, loading, performance improvement, performance issues. If possible/practical, collect photos of equipment, nameplates, setpoints, gauges, screenshots from control systems (such as SCADA or EMIS). Provide a thorough description of the project implemented and how the savings were achieved. List pre and post conditions, setpoints, and equipment specifications where applicable. Confirm annual hours of runtime through conversations with site personnel, control systems, logs, or trends, and list the source if applicable. Provide clear description of the location of upgrade.</p> <p>Calculation Approach: Calculations will use collected site information, data logging or site provided data (if available), and engineering judgement. Calculations may involve bin analyses or seasonal adjustments and may use PA-approved tools if</p>	VFDs; lighting upgrades; replace pneumatic pump with electric; HVAC schedules and setbacks; compressed air valve replacement; compressor controls; economizer optimization; lighting upgrade to LED; chiller temperature adjustments

	EPIA Electric Savings	EPIA Gas Savings	Baseline/Implementation Verification Techniques	Examples (not exhaustive or exclusive)
			applicable. Normalization to production or weather is recommended, if applicable.	
D	Greater than 500,000 kWh	Greater than 200,000 Therms	<p>Process: While the SEM M&V Guide does not require a specific M&V Plan for bottom-up EPIAs, it is best practice to describe an M&V strategy for EPIAs with this level of savings. Required supporting information and data will be collected prior to installation of the EPIA to validate assumptions in the savings analysis. Often, site personnel can provide post-installation data and information, therefore, a post-installation site visit may not be necessary if the information can be collected remotely. If a pre-installation visit cannot be completed or is not relevant, the implementer will justify the reason a site visit was not completed.</p> <p>Pre Supporting Information: Datalogging/interval monitoring/historical trend data is typical. Duration is a professional judgment and depends on the patterns of variability in the measured quantities. Sufficient duration is needed to capture the operating modes needed to extrapolate monitored results to an annual basis.</p> <p>Post Supporting Information: Repeat as above. Photos of equipment, nameplates, setpoints, gauges are typical. Provide a thorough description of the project implemented and how the savings were achieved. List pre and post conditions, setpoints, and equipment specifications where applicable. Confirm annual hours of runtime through conversations with site personnel, control systems, logs, or trends, and list the source if applicable. Provide clear description of the location of upgrade.</p> <p>Calculation Approach: Calculations will use collected site information, data logging or site provided data, and engineering judgement. Calculations will account for production variation, any seasonal weather variation, and Non-Routine Events, if applicable. Calculations may involve bin analyses, modeling tools, or may use</p>	Large projects: Capital claimed through SEM program or BRO

3058

EPIA Electric Savings	EPIA Gas Savings	Baseline/Implementation Verification Techniques	Examples (not exhaustive or exclusive)
		PA-approved tools if applicable. Cascading effects between EPIAs will be taken into account, if applicable.	

Annex E – Multicollinearity and Autocorrelation

Multicollinearity

Multicollinearity is present when two or more relevant variables in a regression model are correlated between themselves. When two relevant variables are correlated, including both variables, instead of just one, may not add appreciably to the model's explanatory power.

Keep the following points in mind when validating an adjustment model:

- The presence of correlated variables should serve as a warning that the statistical significance of a variable in a particular regression model does not, by itself, indicate how closely that variable is correlated with energy consumption. The modeler should use caution in excluding any variables that may actually be relevant variables, but are masked by correlated variables.
- Multicollinearity has limited influence on the predictive capability of the final model if operating conditions stay relatively consistent. However, if the relationship between the correlated relevant variables changes during the Reporting Period, the model will lose predictive power.
- Multicollinearity can be identified by using XY scatterplots to view the relationship between two relevant variables. Additionally, the coefficients in a model will swing drastically if a variable with multicollinearity is added or removed.
- Perform a general assessment of multicollinearity by regressing each variable against the other hypothesis variables and examine the R^2 of each relationship. As a rule of thumb, any bivariate correlation with $R^2 > 0.7$ is an indication that multicollinearity needs to be carefully considered in the variable selection process.
- Multicollinearity can also be identified by calculating the variance inflation factor (VIF), which describes the increase in standard error compared to the standard error if the variable were uncorrelated with the other predictor variables.
- The simplest solution to addressing multicollinearity is to drop one of the variables from the regression analysis. However, this approach may negatively affect the model's predictive capability. The modeler should use his/her best engineering judgment along with an understanding of how the customer's site uses energy to include or exclude variables, while considering factors such as data availability and model complexity.

EXAMPLE: At a soft drink bottling site, energy consumption and production increase in the summer, due to higher seasonal sales. Both energy and production show a strong correlation with ambient, dry bulb temperature. The modeler includes the production variable in the adjustment model, but is unsure whether to include the ambient temperature variable. In this example, plot the production variable against the temperature variable to determine the correlation. If the R^2 is greater than 0.7, consider removing the temperature variable from the model. Justify the decision using engineering knowledge about the temperature dependency of equipment and loads at the site.

Autocorrelation

Autocorrelation is present when the error term in a time period is related to the error term in a prior time period. In other words, autocorrelation is characterized by a correlation in the residuals.

Calculate the autocorrelation coefficient and plot model residuals over the Baseline Period. If autocorrelation is detected, the number of independent baseline points is effectively reduced.

3104 The typical remedy involves increasing the sample size, or selecting a different data interval.
3105 For annual models with daily baseline intervals, moderate autocorrelation may not be a concern.
3106 According to ASHRAE Guideline 14:2014, for monthly data an assumption that autocorrelation
3107 is 0 so n' is equal to n .
3108 Typically, regression-based energy models exhibit positive autocorrelation. Positive auto-
3109 correlation occurs when the sign change of the residuals is infrequent. Conversely, too frequent
3110 sign changes in the residual pattern results in negative autocorrelation.
3111 There is no defined threshold for the autocorrelation coefficient in the model development
3112 phase. Autocorrelation becomes a factor in the fractional savings uncertainty analysis when it
3113 has the mathematical effect of reducing performance period energy data samples.
3114 The Durbin-Watson test can also be used to determine if autocorrelation is statistically
3115 significant. For uncorrelated errors, the Durbin-Watson number, d , should be approximately 2.
3116 The upper and lower bounds for the Durbin-Watson statistic are a function of sample size, the
3117 number of predictor variables and desired confidence level.

3118

3119 **Annex F – Graphical Representation of the Table of Competing Models**
3120 A graphical representation of the table of competing models is provided below. Refer to Section 7.8.4 for details.
3121

Model reference number	Data interval	Baseline Period start and end dates	Upcoming Reporting Period start and end dates	R ²	Net determination bias	Coefficient of variation	Durbin Watson	Projected FSU	Comments	Name of Relevant Variable	Relevant variable Coefficient Value	T-stat	P-value
Model 1													
Model 2													
Model 3													

3122
3123

3124 **Annex G – Fractional Savings Uncertainty Scenarios**

Daily Model					
68% confidence, 365 baseline intervals, 90 reporting intervals					
	F (% savings)				
CV	2.5%	5.0%	10.0%	15.0%	20.0%
0.03	23%	12%	6%	4%	3%
0.05	46%	23%	12%	8%	6%
0.10	92%	46%	23%	15%	12%
0.15	139%	69%	35%	23%	17%
0.20	185%	92%	46%	31%	23%
0.30	277%	139%	69%	46%	35%

68%	confidence
1.00	T-stat
365	baseline intervals
90	reporting intervals
0.5	autocorrelation coefficient
121.67	n-prime

Weekly Model					
68% confidence, 52 baseline intervals, 13 reporting intervals					
	F (% savings)				
CV	2.5%	5.0%	10.0%	15.0%	20.0%
0.03	47%	23%	12%	8%	6%
0.05	93%	47%	23%	16%	12%
0.10	187%	93%	47%	31%	23%
0.15	280%	140%	70%	47%	35%
0.20	374%	187%	93%	62%	47%
0.30	561%	280%	140%	93%	70%

68%	confidence
1.00	T-stat
52	baseline intervals
13	reporting intervals
0.25	autocorrelation coefficient
31.20	n-prime

Monthly Model					
68% confidence, 12 baseline intervals, 3 reporting intervals					
	F (% savings)				
CV	2.5%	5.0%	10.0%	15.0%	20.0%
0.03	82%	41%	20%	14%	10%
0.05	164%	82%	41%	27%	20%
0.10	327%	164%	82%	55%	41%
0.15	491%	246%	123%	82%	61%
0.20	655%	327%	164%	109%	82%
0.30	982%	491%	246%	164%	123%

68%	confidence
1.04	T-stat
12	baseline intervals
3	reporting intervals
0	autocorrelation coefficient
12.00	n-prime

Notes: ASHRAE guidelines specify 50% uncertainty at 68% confidence.
100% uncertainty means that the savings are not negative.
Uncertainty higher than 100% means there is a chance that savings are negative.
Monthly models will generally not show autocorrelation.
Daily and weekly models will generally show autocorrelation. Usually the addition of production data lowers the autocorrelation.

3125

Annex H – Cumulative and Incremental Savings Example

This annex provides a six-year example of how incremental energy savings would be calculated assuming an energy consumption adjustment model was valid for that full time period. Two scenarios of the same example are provided based upon an assumption of how backsliding would be reported.

Scenario 1: Backsliding reported as 0 energy savings:

SEM Program Year	Cumulative Site-wide Energy Savings	Incremental Site-wide Energy Savings
1	200,000	200,000
2	300,000	100,000
3	250,000	0
4	500,000	200,000
5	600,000	100,000
6	550,000	0

Table 6: Example of Cumulative and Incremental Energy Savings and not Reporting Negative Savings

Note that SEM Program Years 3 and 6 showed backsliding and a reduction of cumulative Site-wide Energy Savings. It is assumed the implementer could not show any reason why such backsliding should occur due to the SEM program (for example multiple EPIAs were installed in the Reporting Periods) and so a reported energy savings value of 0 was claimed. See Section 10.6 for more details.

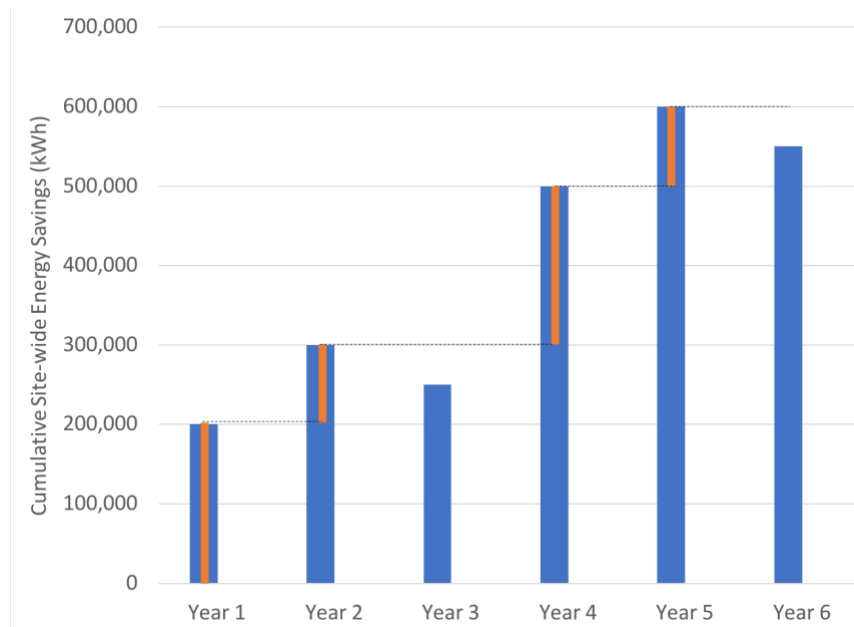


Figure 8: Example of Cumulative and Incremental Energy Savings and not Reporting Negative Savings.

In this chart blue bars are cumulative energy savings, orange bars are reportable incremental savings.

Scenario 2: Backsliding claimed as negative energy savings values.

If the implementer showed reason for the backsliding, or could not show evidence the SEM program was taking positive actions to reduce energy consumption such as the implementation of EPIAs, then the energy savings values of -50,000 kWh should be claimed in SEM Program Years 3 and 6. An updated table of savings and figure assuming this approach is taken is shown below

SEM Program Year	Cumulative Site-wide Energy Savings	Incremental Site-wide Energy Savings
1	200,000	200,000
2	300,000	100,000
3	250,000	-50,000
4	500,000	300,000
5	600,000	100,000
6	550,000	-50,000

Table 7: Example of Cumulative and Incremental Energy Savings and Reporting Negative Savings

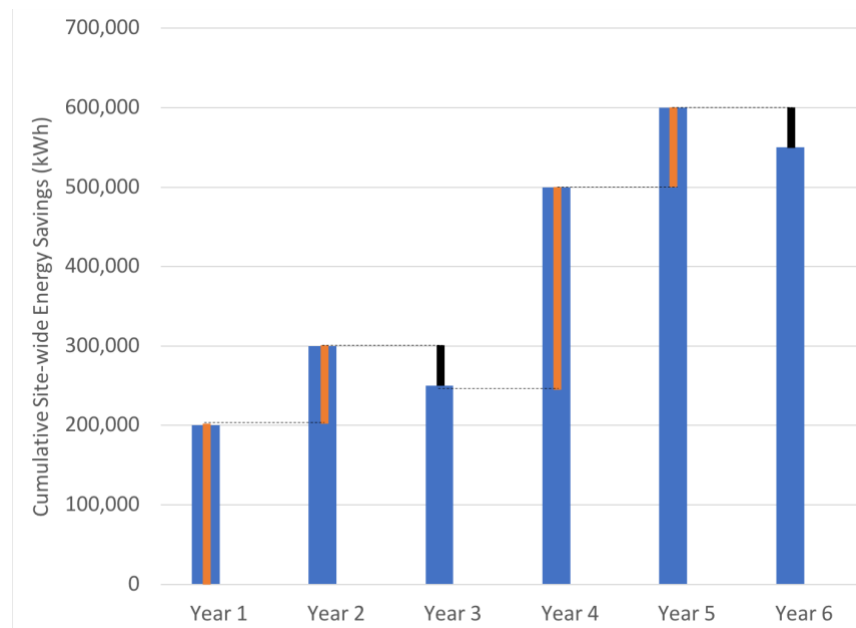


Figure 9: Example of Cumulative and Incremental Energy Savings and Reporting Negative Savings.

In this chart blue bars are cumulative energy savings, orange bars are reportable incremental savings, and black bars are reported negative savings.

Annex I – Total System Benefits

This Annex provides information pertaining to the concept of Total System Benefits (TSB). This Annex provides quotes taken from the CPUC document, “Total System Benefit Technical Guidance,” Version 1.2, released October 25, 2021. CPUC authors state that this document is, “CPUC staff-level guidance introduces and describes the calculation steps for the Total System Benefit (TSB) metric implemented by D.21-05-031.” All statements in quotation marks in this section are direct quotes from the CPUC technical guidance document.

The provided statements are intended to be informative about changes the CPUC is making on how it will be valuing ratepayer funded energy efficiency programs. The statements focus on information that may help in making changes in program and M&V approaches in the future.

PA staff should be consulted for full and up to date details about TSB.

The TSB metric creates, “a single goal expressed in dollars, which represents the value of the energy efficiency resources to the grid.” In short, the TSB metric will encourage PAs to, “optimize portfolios to save energy during high value hours.”

“The TSB metric was adopted in D.21-05-031 as the official metric for energy efficiency portfolio planning starting in 2024, but PAs should informally file and report on the metric in program years 2022 and 2023.” “Starting in 2024, the TSB metric will replace kWh, kW, and Term as the primary goal for the energy efficiency portfolios administered by the California investor-owned utilities and other program administrators.”

TSB will, “encourage program administrators to pursue energy savings that deliver high value in some or all of the avoided cost categories:

- Energy,
- Generation capacity,
- Ancillary services,
- Transmission and distribution capacity,
- High global warming potential (GWP) gases, and
- GHGs.”

“The GHG costs include both carbon (expressed through the GHG adder) and high global-warming potential gasses, such as methane and refrigerants.”

As TSB looks to quantify the value of energy efficiency to the grid, the time at which energy savings are realized is important. Because the SEM M&V process tracks actual energy consumption with as much fidelity as possible, data from the SEM program could be of value in developing actual TSB time of energy savings value as compared to industry average load shapes that may not reflect a customer’s actual operations.

Annex J – Revision History

The below table documents changes made to this M&V Guide.

Version and Date	Section	Change
2.0, September 12, 2020	Document	Structural and technical updates to version 1.0 originally published February 8, 2017.
2.01, September 12, 2020	All tables	Corrected table formatting
2.02, September 28, 2020	11.5.3	Corrected equation to annualize correctly for non 12 month reporting periods. Last term change from $\left(\frac{rp}{n}\right)$ to $\left(\frac{n_{year}}{n}\right)$ where rp = number of intervals in the Reporting Period, n = number of intervals in the Annualization Period, and n_{year} = number of intervals in a year.
2.99, May 2, 2022	Document	Technical updates to version 2.02 reflecting IOU sponsored M&V working group, CPUC evaluation report, and custom survey results as well as alignment with 2022 Design Guide.
3.00 June 13, 2022	Document	Incorporation of technical and editorial comments on version 2.99. Comment resolution available in separate tracking document.

Table 8: Revision History.